

HAMPTON ROADS SANITATION DISTRICT




PROJECT TITLE

CIP NUMBER


(LOCATION: CITY/COUNTY & STATE)

DATE (MONTH & YEAR)

**LEGEND
(ON SEPARATE PAGE FOR
LARGE PROJECTS)**



MAP SCALE



MAP SCALE

**INDEX TO DRAWINGS
(ON SEPARATE PAGE FOR
LARGE PROJECTS)**

ENGINEER'S NAME/LOGO/CONTACT

**RESERVE SPACE FOR DRAWING
ADDITION OF: CONTRACTOR, NAME &
OTHER INFORMATION AS REQUIRED
(PIPE MANUFACTURER, ETC.)**

VERTICAL DATUM:

**ENGINEER'S
SEAL**



STANDARD DESIGN DETAIL

STANDARD COVER SHEET

**DRAWING NO.
100
SHEET
1 OF 1
DATE
1/2021**

PAINT SAFETY YELLOW
TYP. ALL BOLLARDS

6" ϕ , SCHEDULE 80
STEEL PIPE FILLED
WITH CONCRETE

FINISHED GRADE

POURED CONCRETE
(3,500 P.S.I.)

#5 BAR, 12" LONG
THROUGH PIPE

1'-6" SQ.

1" ROUNDING OF CONCRETE

3'-6"

SLOPE TO
DRAIN

4'-0"

6"

NOT TO SCALE








STANDARD DESIGN DETAIL

EXTERIOR BOLLARD DETAIL

DRAWING NO.
101

SHEET
1 OF 1

DATE
1/2021

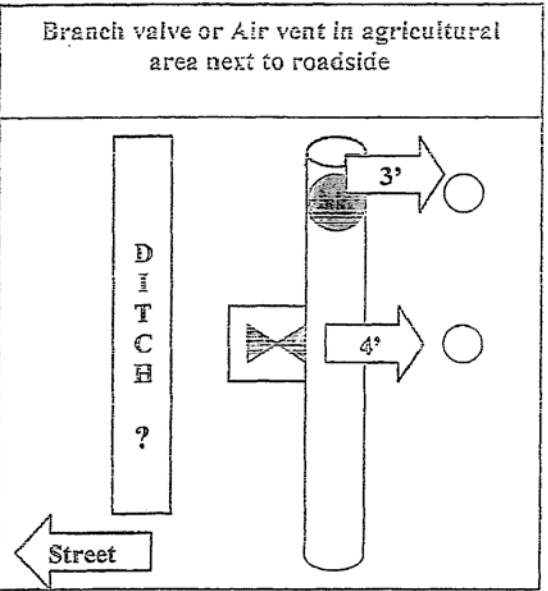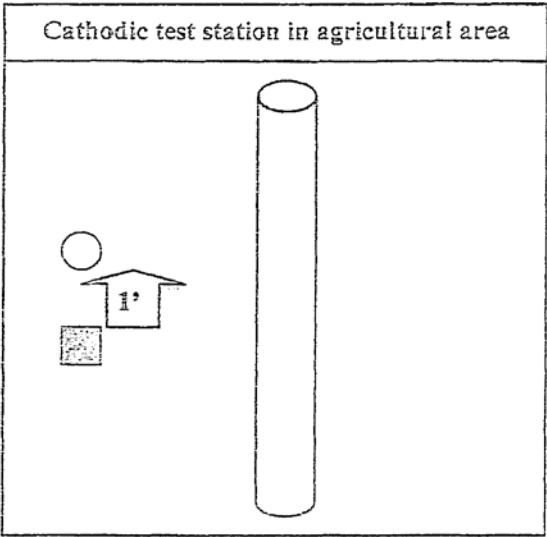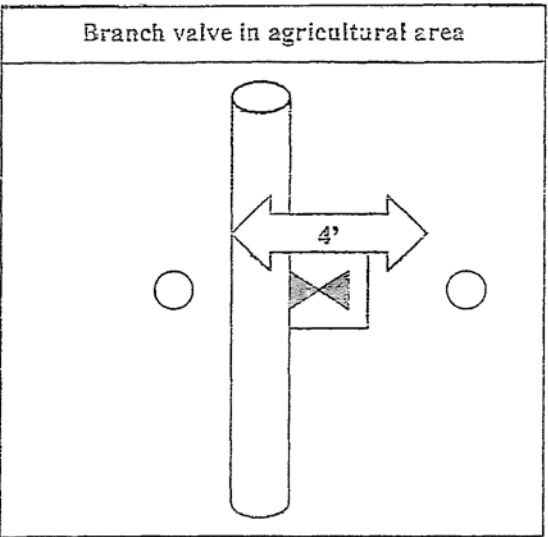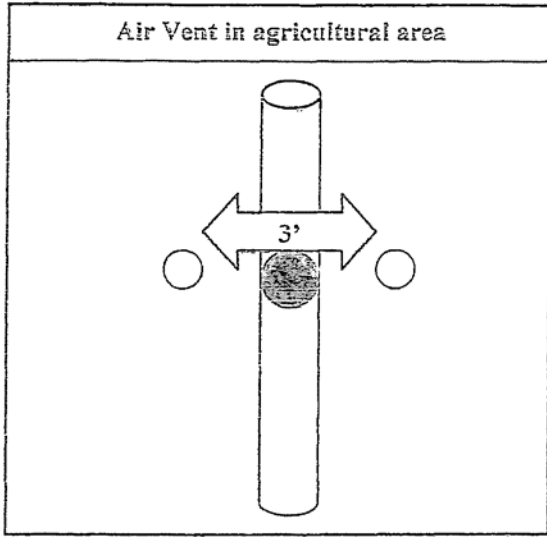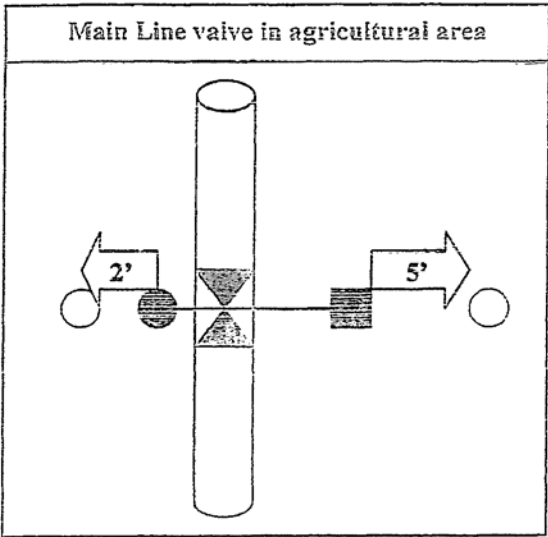

All measurements from center of casting







STANDARD DESIGN DETAIL

BOLLARD LOCATION DETAIL

DRAWING NO.
102

SHEET
1 OF 1

DATE
1/2021

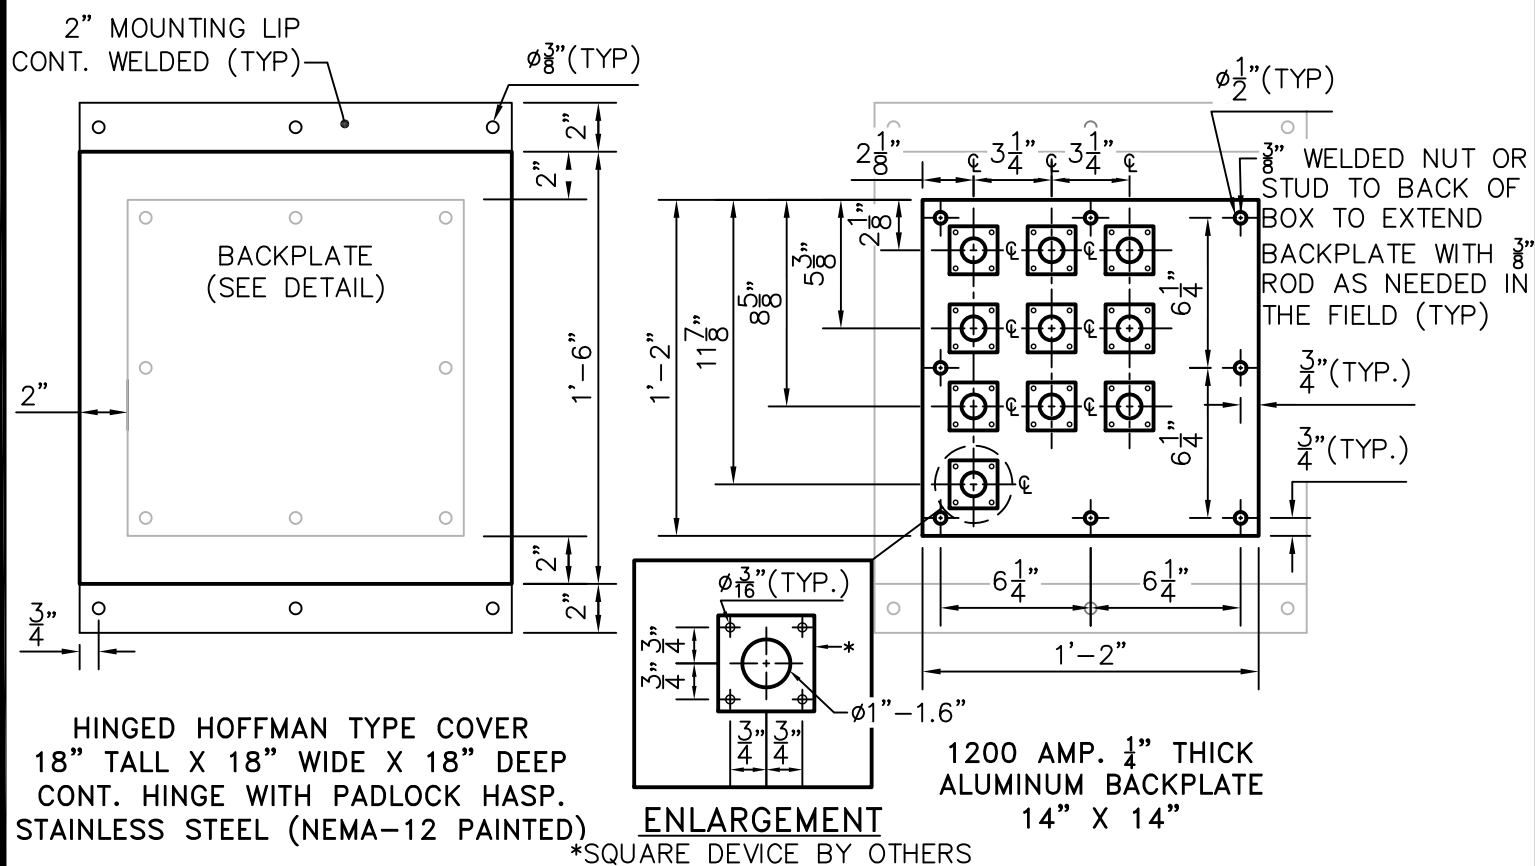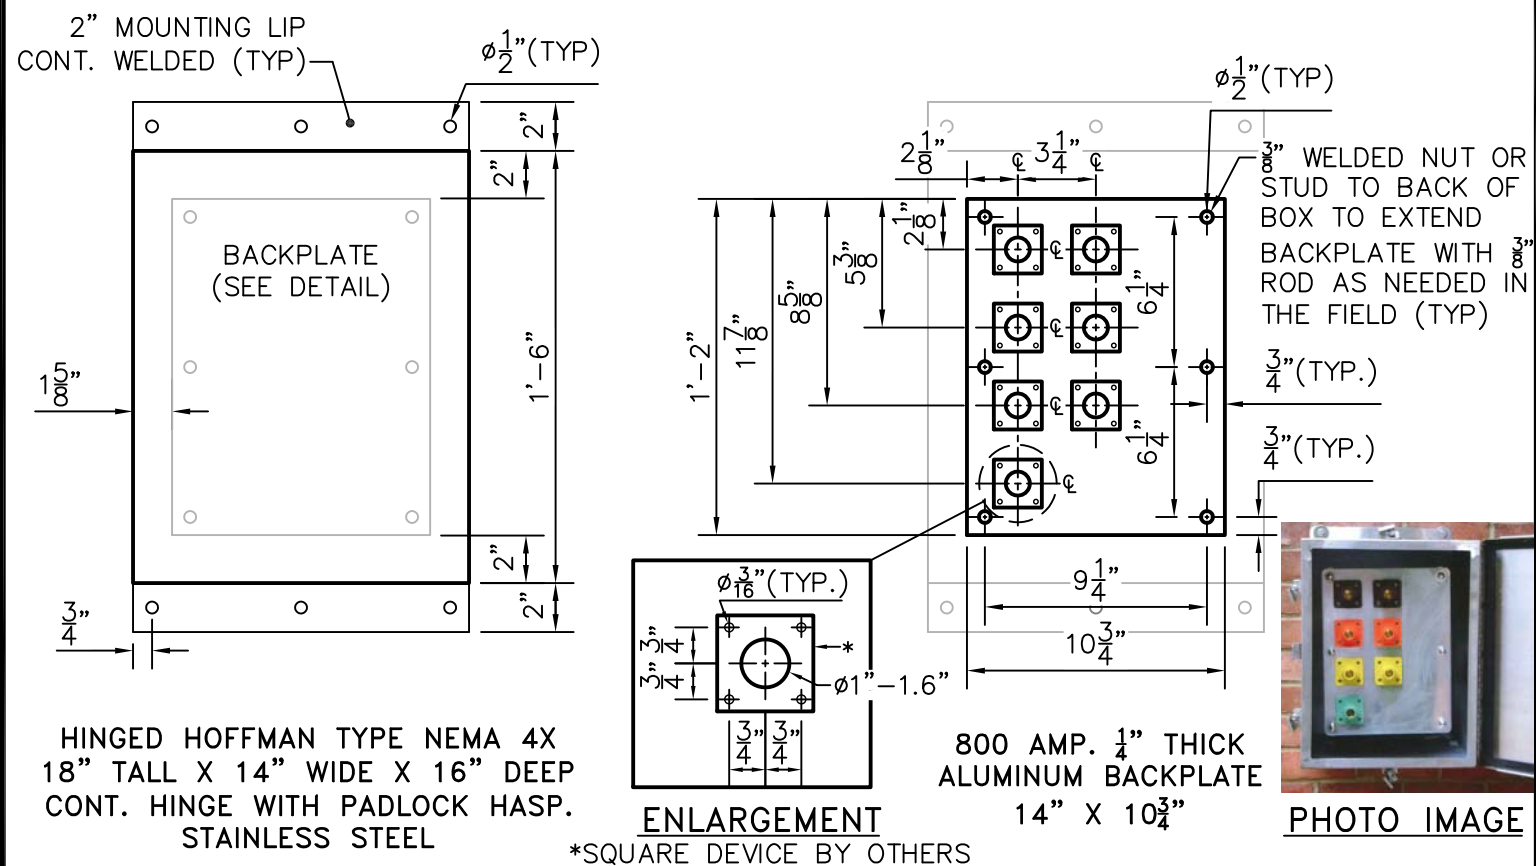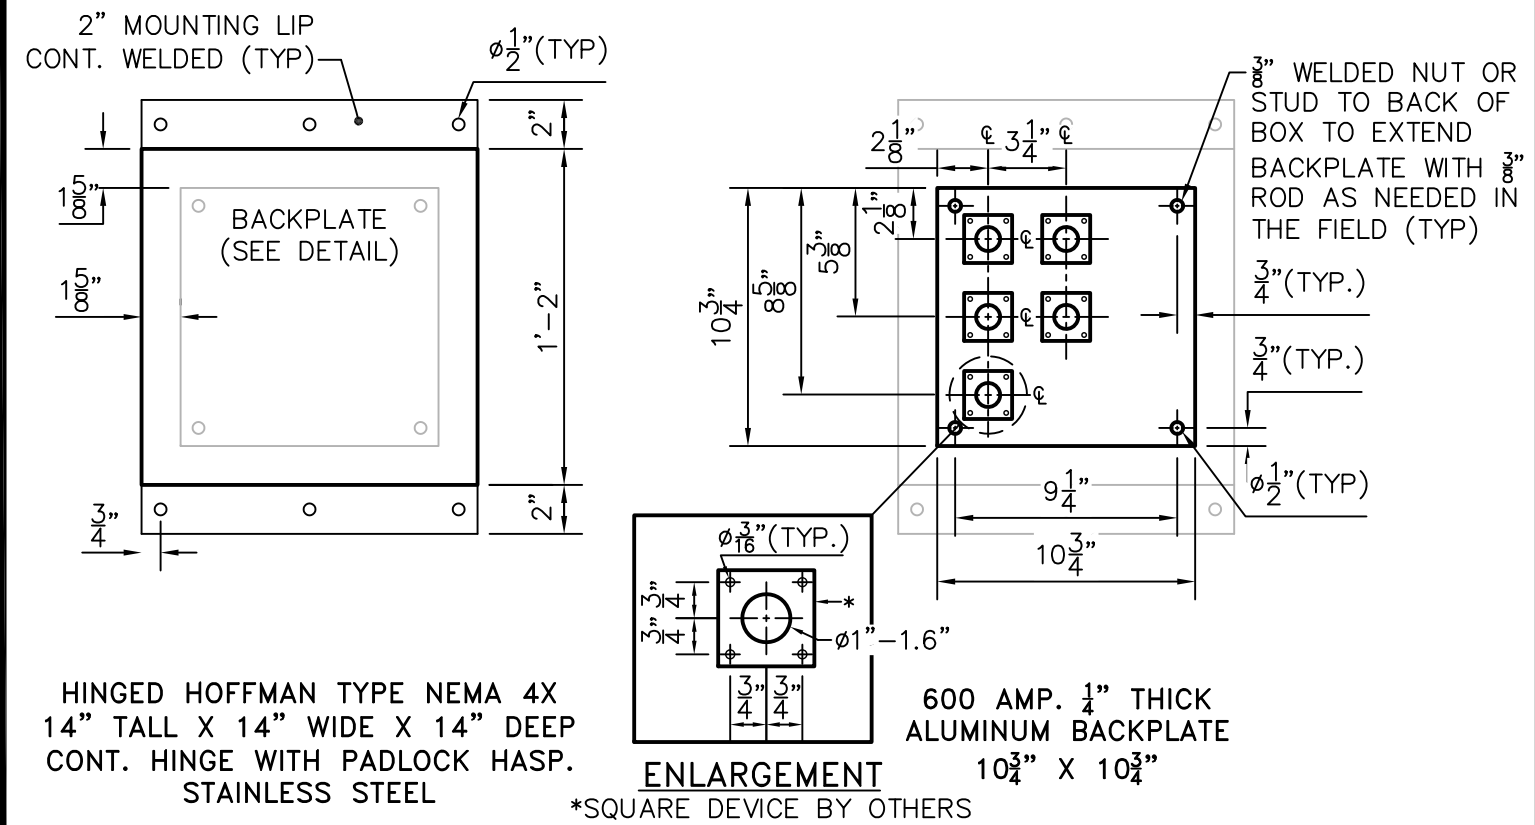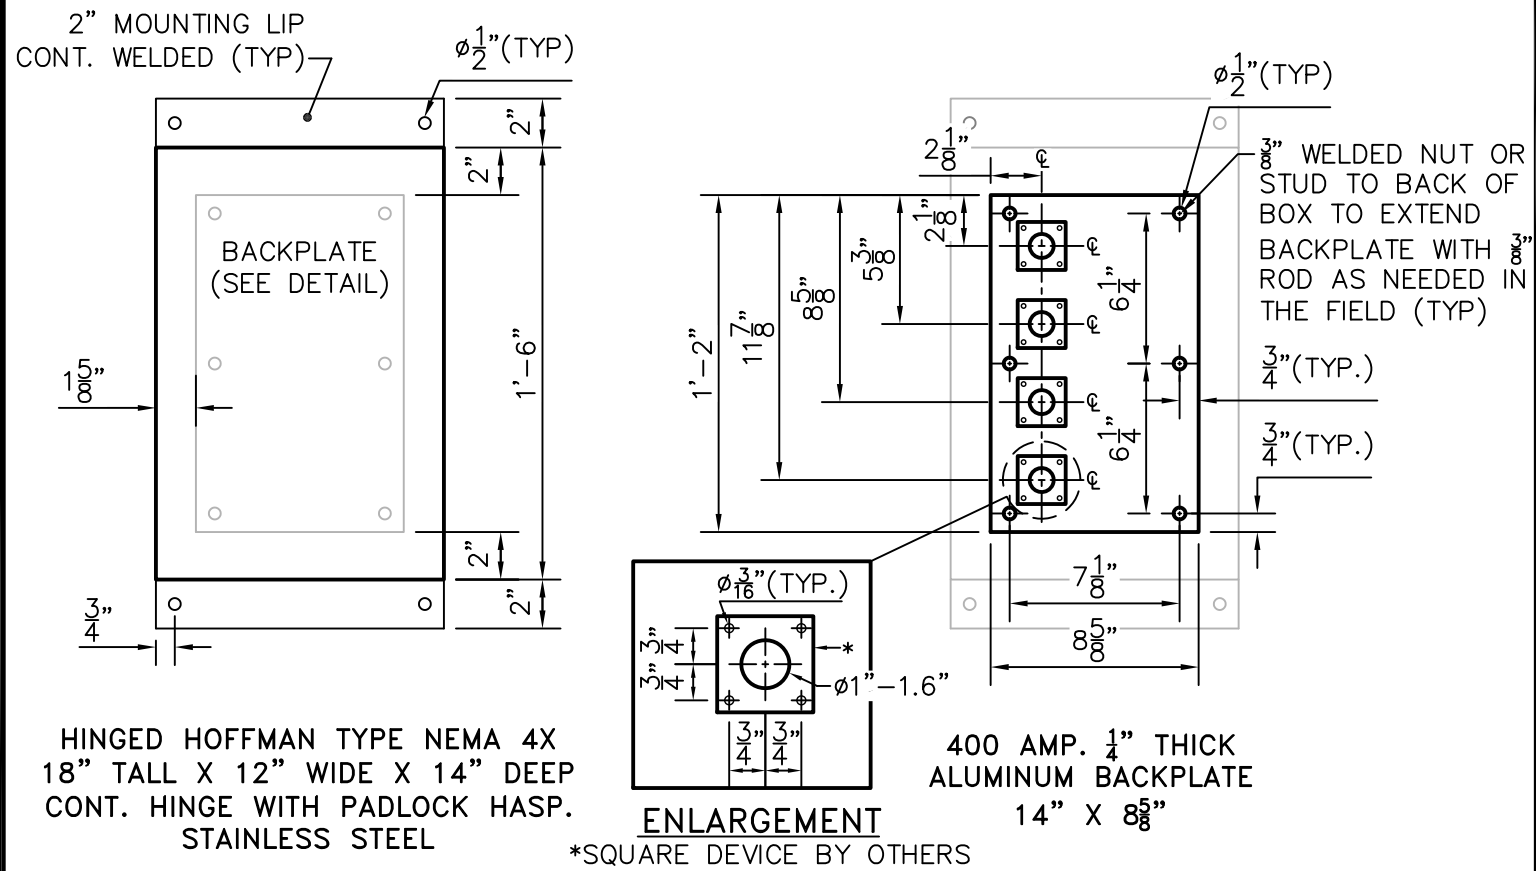

NOTES:

1. TYPICAL DIMENSIONS SHOWN FOR VARIOUS SERVICE SIZES. BOX MUST BE FIELD VERIFIED PRIOR TO FABRICATION AND INSTALLATION.




STANDARD DESIGN DETAIL

LOAD TEST HINGED BANK BOX

DRAWING NO.
103
SHEET
1 OF 1
DATE
1/2021

3/4" PVC COATED RIGID CONDUIT
 A MINIMUM OF 2' BEYOND EXTENT
 OF CONCRETE PAD

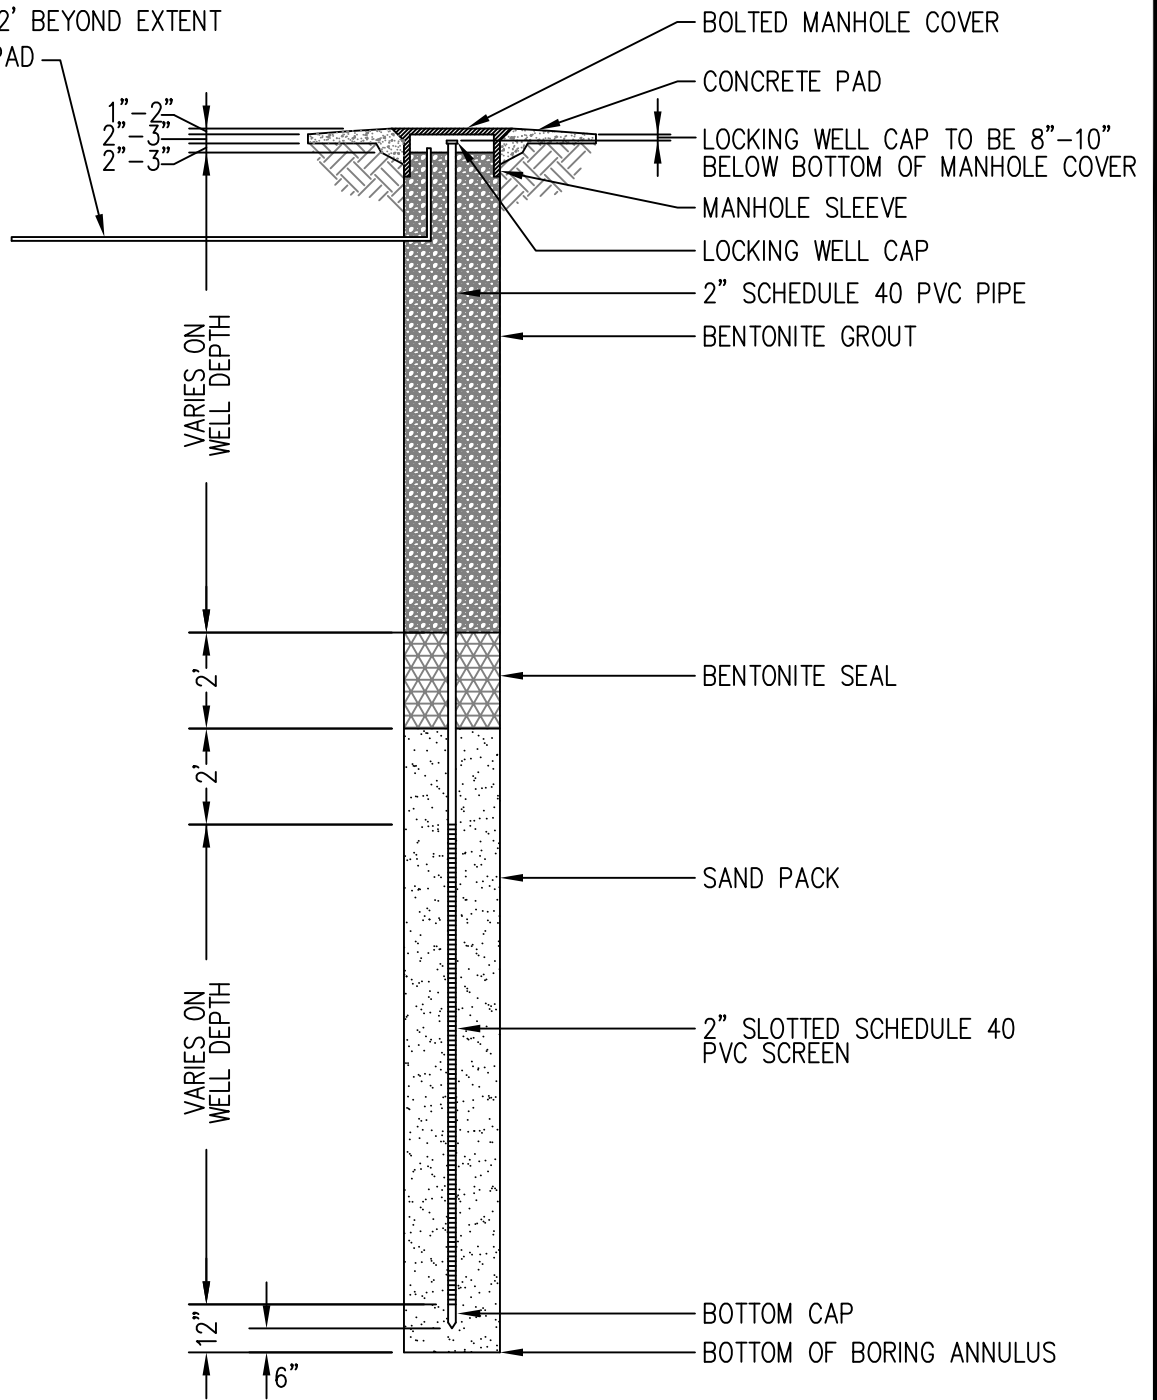

*SEE PAGE 2 FOR DETAIL NOTES

NOT TO SCALE



STANDARD DESIGN DETAIL

FLUSH-MOUNT GROUNDWATER MONITORING WELL


DRAWING NO.	104A
SHEET	1 OF 2
DATE	1/2021

WELL DEPTH (FT)	PVC PIPING DIAMETER	SCREEN LENGTH* (FT)	SLOTING SIZE	RISER PIPE LENGTH (FT)	FILTER SAND MEDIA	SEALING MEDIA	SURFACE FINISHING
VARIABLES	0.75 ID	VARIABLES	0.010	10'-15' DEPTH=2.5' 15'-20' DEPTH=3.5'	#2	BENTONITE GROUT/NEAT CEMENT	FLUSH MOUNT CASING

*SCREENS LENGTHS COME IN 3FT AND 5FT SECTIONS

NOTES:

1. ONCE THE SCREEN INTERVAL IS INSTALLED, A MINIMUM OF 2 FEET OF SAND SHOULD BE PLACED ABOVE THE SCREEN. ONCE INSTALLED, A MINIMUM OF ONE FOOT THICK SEAL OF BENTONITE SLURRY OR NEAT CEMENT GROUT SHOULD BE PLACED.
2. AT FINAL SURFACE GRADE, THE MONITORING WELL SHALL BE PROTECTED WITH FLUSH MOUNT RISER CASING.
3. UPON COMPLETION OF WELL INSTALLATION, THE CONTRACTOR WILL DEVELOP THE WELL TO REMOVE SILT FROM WITHIN THE SCREEN INTERVAL.


	STANDARD DESIGN DETAIL	DRAWING NO. 104B
		SHEET 2 OF 2
	FLUSH-MOUNT GROUNDWATER MONITORING WELL	DATE 1/2021

LOCATION SKETCH

NOT TO SCALE

"STATION NAME" PUMP STATION

#XXX



Station Location

VICINITY MAP

SCALE: 1" = 1 MILE

SITE ADDRESS: XXXXXXXXXXXX

HORIZONTAL CONTROL:

VIRGINIA STATE PLANE COORDINATE SYSTEM, SOUTH ZONE
NORTH AMERICAN DATUM 1983/1996 CORS ADJUSTMENT (US SURVEY FOOT)

NORTH (FT):	<u> X,XXX,XXX.XX </u>	EAST (FT):	<u> XX,XXX,XXX.XX </u>
NORTH (m):	<u> X,XXX,XXX.XXX </u>	EAST (m):	<u> X,XXX,XXX.XXX </u>
LATITUDE:	<u> XX°XX'XX.XXXXX" N </u>	LONGITUDE:	<u> XX°XX'XX.XXXXX" W </u>
SCALE FACTOR:	<u> X.XXXXXXXXXX </u>	CONVERGENCE:	<u> X°XX'XX.XXXXX" </u>

DESCRIPTION:

TO REACH THE DISK FROM XXXXXXXXX

VERTICAL CONTROL:

NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD 88)
U.S. SURVEY FEET (DIFFERENTIAL LEVELING)
ELEVATION XX.XX'

DATE ESTABLISHED:	<u> </u>
GPS DATE:	<u> XX/XX/XXXX </u>
DATE RECOVERED:	<u> </u>



Cleaning wastewater every day for a better Bay.

2389 G AVENUE, NEWPORT NEWS, VA 23602



STANDARD DESIGN DETAIL

RECOVERY SHEET TEMPLATE

DRAWING NO.
105

SHEET
1 OF 1

DATE
1/2021