


Controlwave & Telog Wiring Details

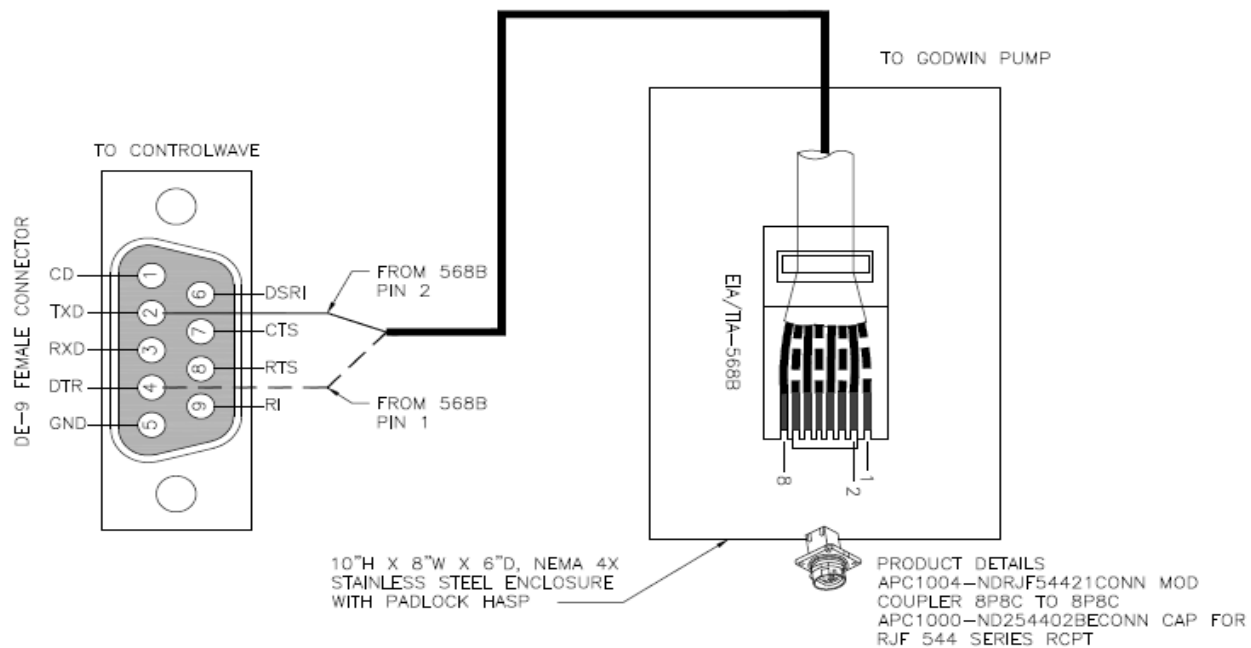

HRSD

STANDARD DESIGN DETAIL

TEMPORARY PUMP ENCLOSURE DETAIL

DRAWING NO.
703

SHEET
1 OF 1

DATE
12/2022

Elementary Pump Station Wiring Schematic for:
Pump Running Status to Local PLC (Control Wave) and Telog

