




NOTES:

1. REFERENCE SPECIFICATION 03700 FOR CONCRETE REBUILD INFORMATION NOT OTHERWISE SHOWN.
2. GALVANIC ANODE SIZES AND SHAPES MAY VARY.

NOT TO SCALE

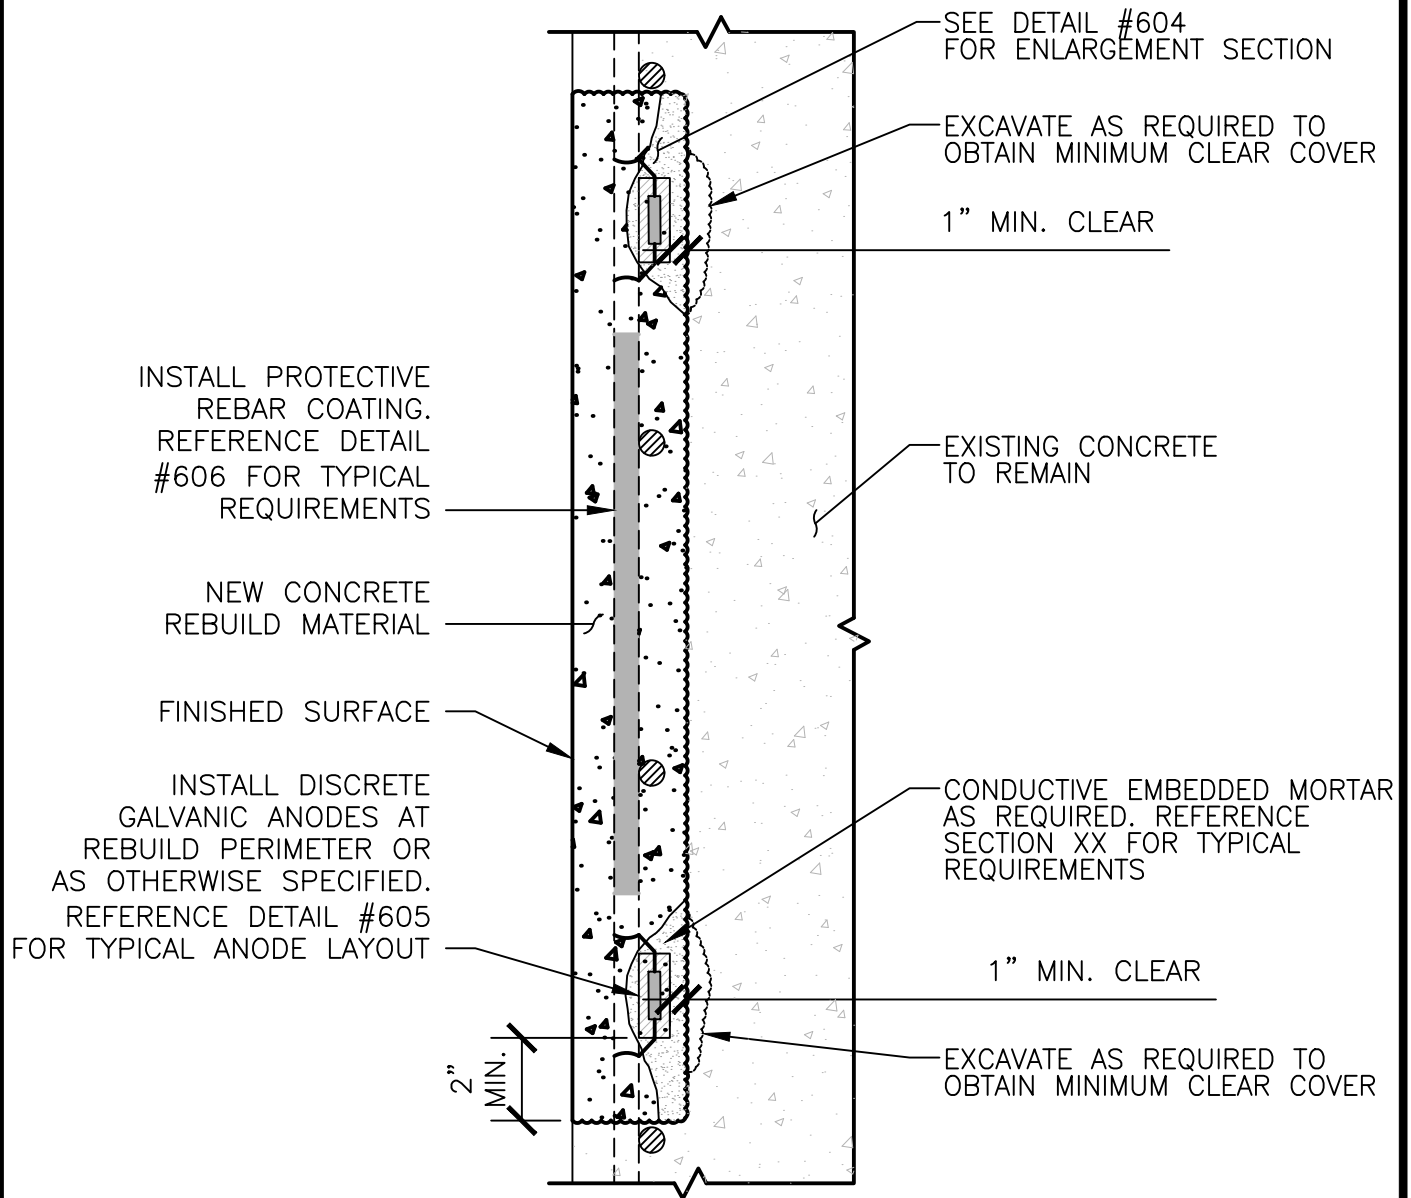


STANDARD DESIGN DETAIL

INSTALLATION OF
DISCRETE GALVANIC ANODES

DRAWING NO.
600

SHEET
1 OF 1

DATE
7/2025

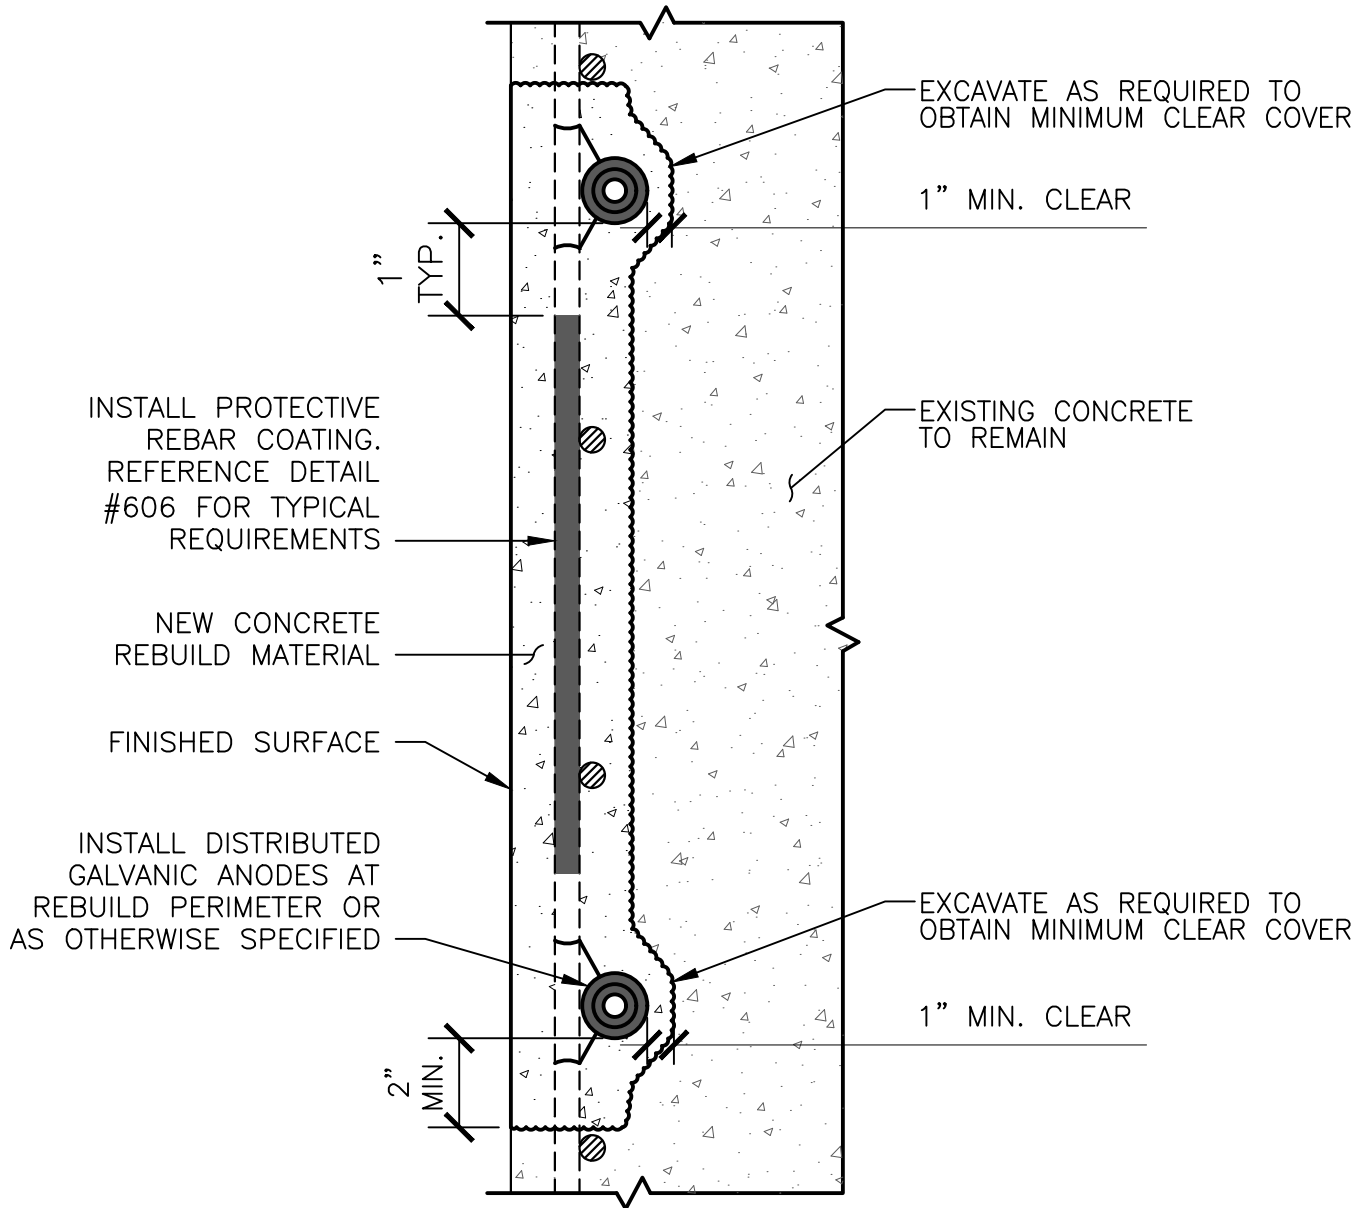

NOTES:

1. REFERENCE SPECIFICATION 03700 FOR CONCRETE REBUILD INFORMATION NOT OTHERWISE SHOWN.
2. CONDUCTIVE MORTAR NOT SHOWN. ENCAPSULATE ANODES IN CONDUCTIVE MORTAR AS REQUIRED BY MANUFACTURER.
3. GALVANIC ANODE SIZES AND SHAPES MAY VARY.

NOT TO SCALE




STANDARD DESIGN DETAIL

INSTALLATION OF
DISTRIBUTED GALVANIC ANODES

DRAWING NO.
601

SHEET
1 OF 1

DATE
7/2025

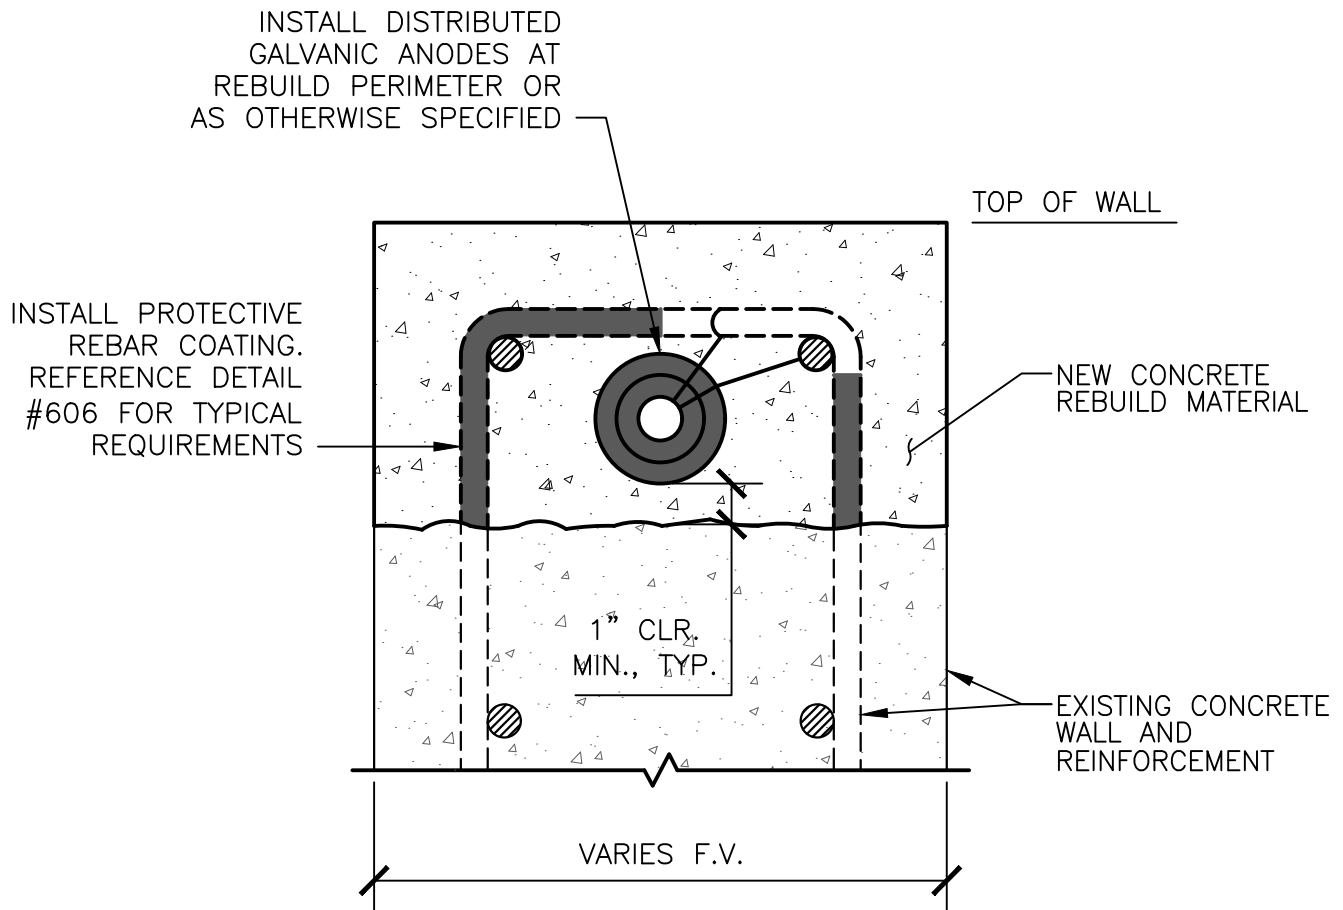

NOTES:

1. REFERENCE SPECIFICATION 03700 FOR CONCRETE REBUILD INFORMATION NOT OTHERWISE SHOWN.
2. CONDUCTIVE MORTAR NOT SHOWN. ENCAPSULATE ANODES IN CONDUCTIVE MORTAR AS REQUIRED BY MANUFACTURER.
3. GALVANIC ANODE SIZES AND SHAPES MAY VARY.

NOT TO SCALE



STANDARD DESIGN DETAIL

DISTRIBUTED GALVANIC ANODES
AT TOP OF WALL

DRAWING NO.



602

SHEET

1 OF 1

DATE

7/2025

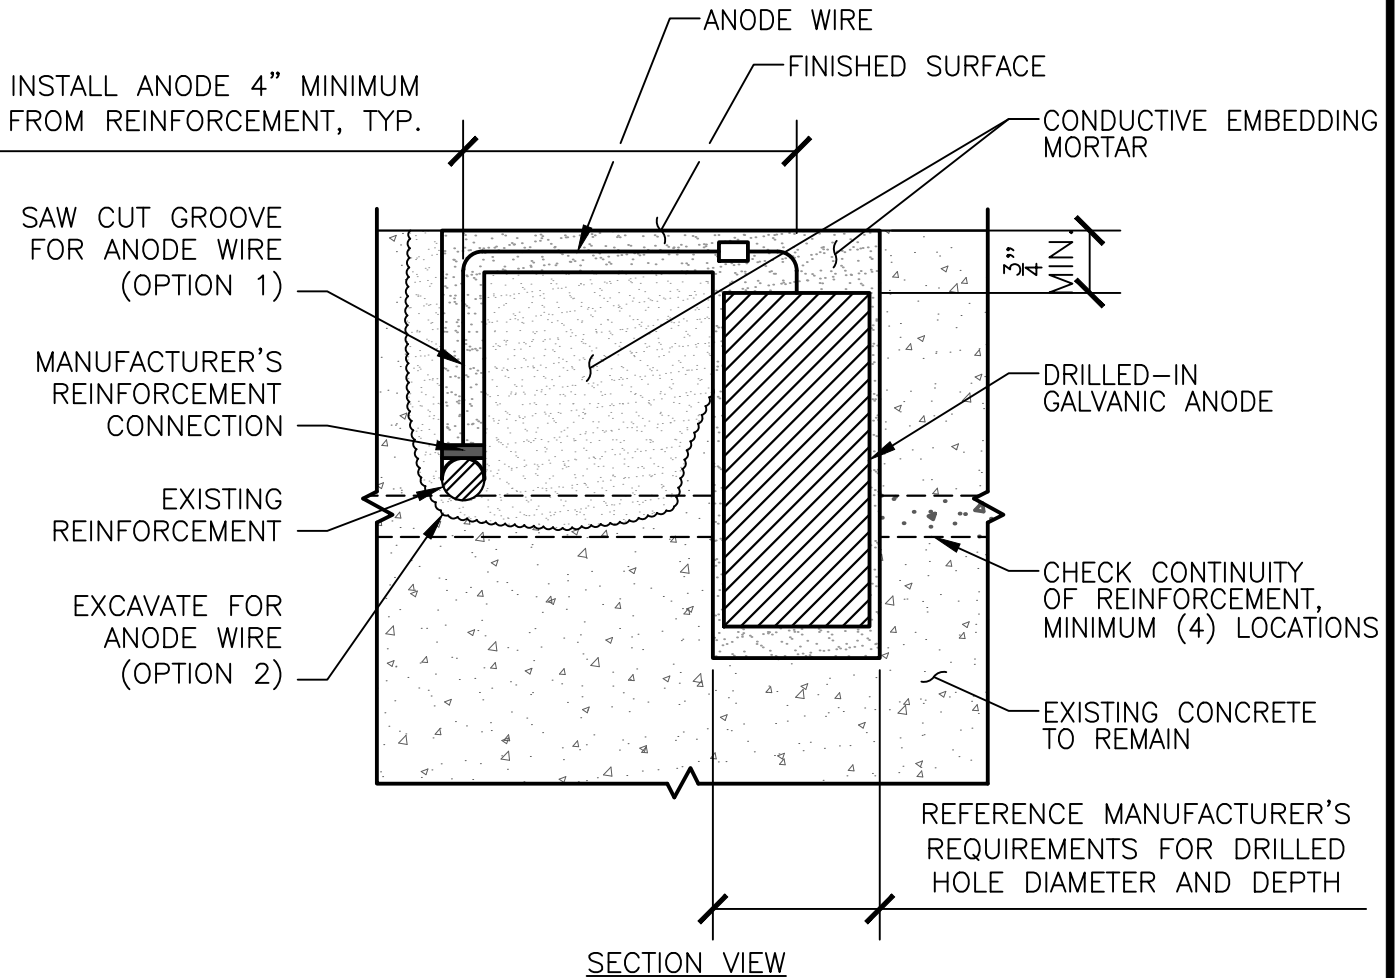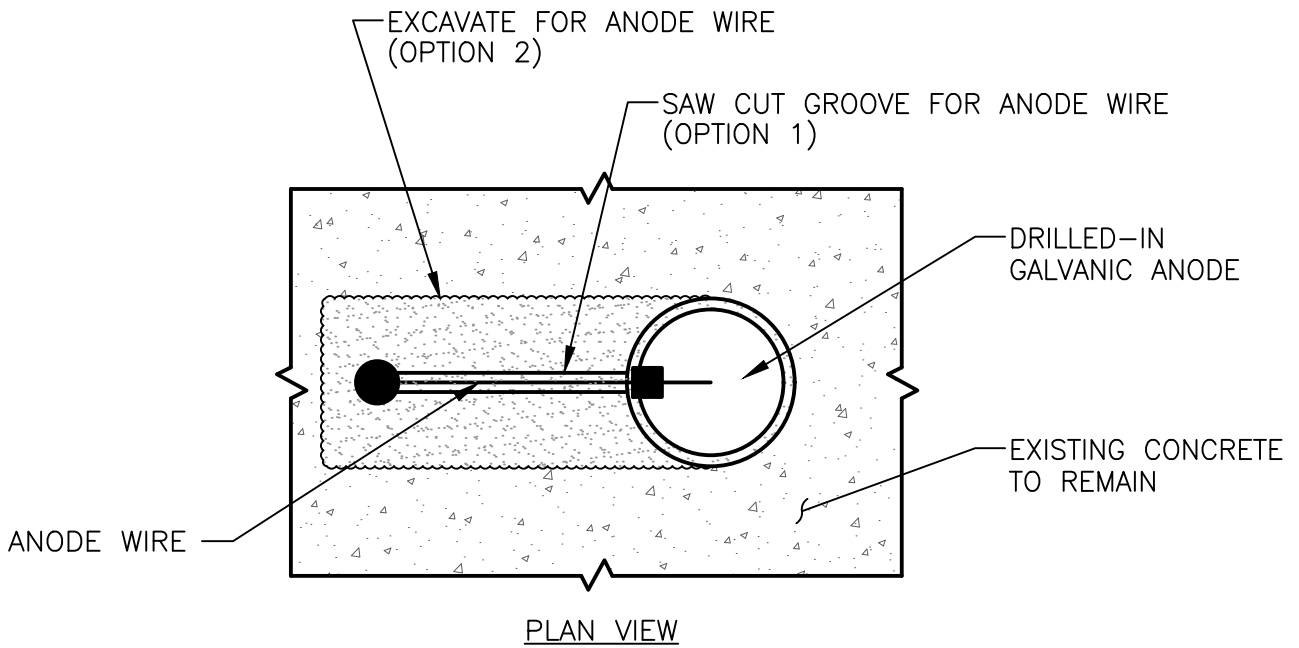

NOT TO SCALE



STANDARD DESIGN DETAIL

INSTALLATION OF DRILLED-IN GALVANIC ANODES

DRAWING NO.


603

SHEET

1 OF 1

DATE

7/2025

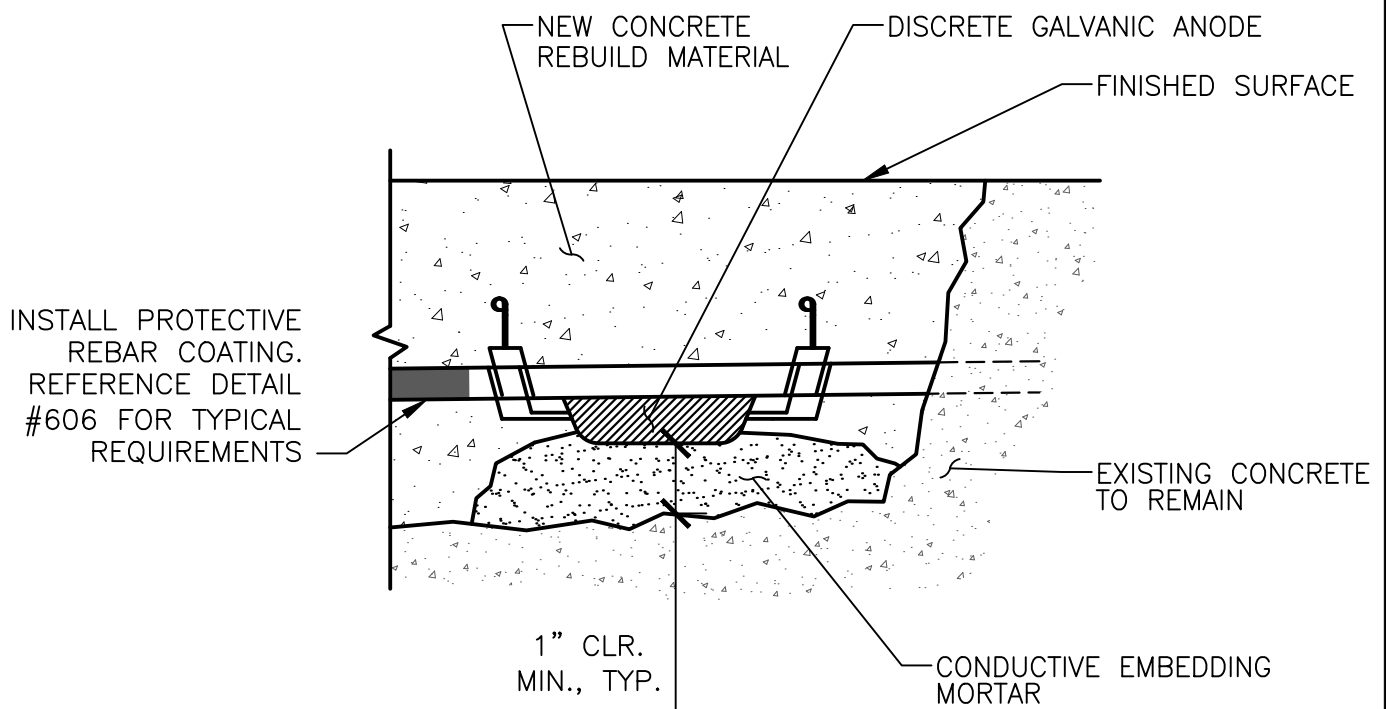

NOTES:

1. CONDUCTIVE BEDDED MORTAR SHALL BE INSTALLED FOR ANODES WHEN NEW CONCRETE REBUILD MATERIAL ELECTRICAL RESISTIVITY IS GREATER THAN 15,000 OHM-CM.
2. GALVANIC ANODE SIZES AND SHAPES MAY VARY.

NOT TO SCALE




STANDARD DESIGN DETAIL

CONDUCTIVE MORTAR BRIDGE FOR USE
WITH HIGH RESISTIVITY REPAIR MORTARS

DRAWING NO.
604

SHEET
1 OF 1

DATE
7/2025

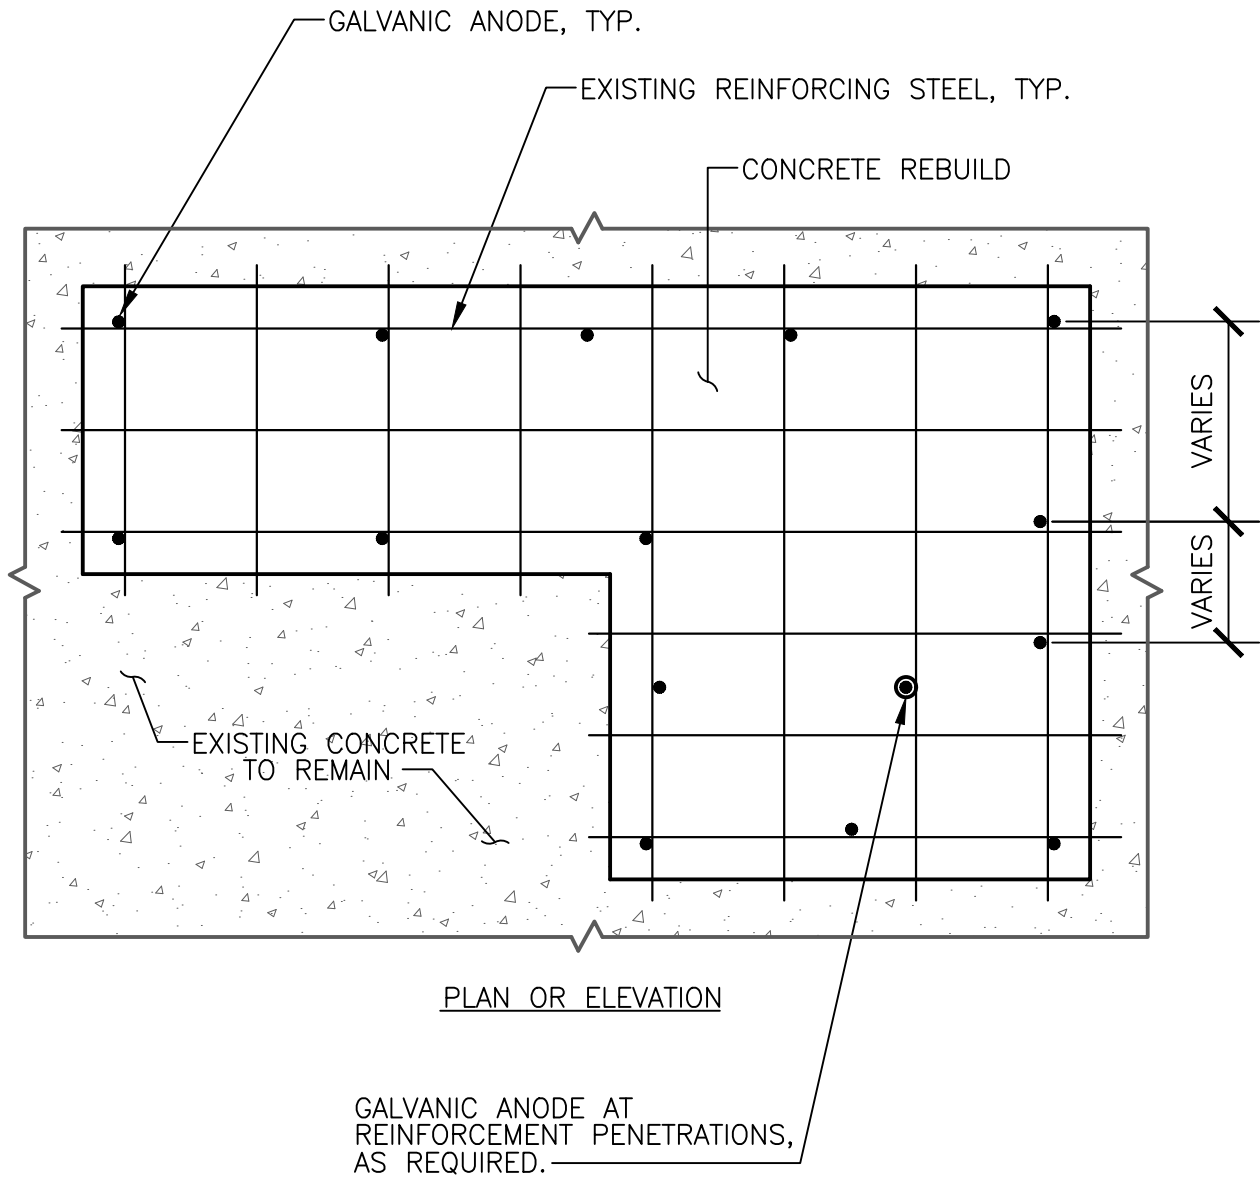

NOTES:

1. REFERENCE SPECIFICATION 03700 FOR CONCRETE REBUILD INFORMATION NOT OTHERWISE SHOWN.
2. GALVANIC ANODE SPACING SHALL BE IN ACCORDANCE WITH SPECIFICATION REQUIREMENTS.
3. SEE DETAIL #606 FOR TYPICAL ANODE CONNECTION DETAILS.

NOT TO SCALE



STANDARD DESIGN DETAIL

TYPICAL GALVANIC ANODE LAYOUT

DRAWING NO.


605

SHEET


1 OF 1

DATE


7/2025

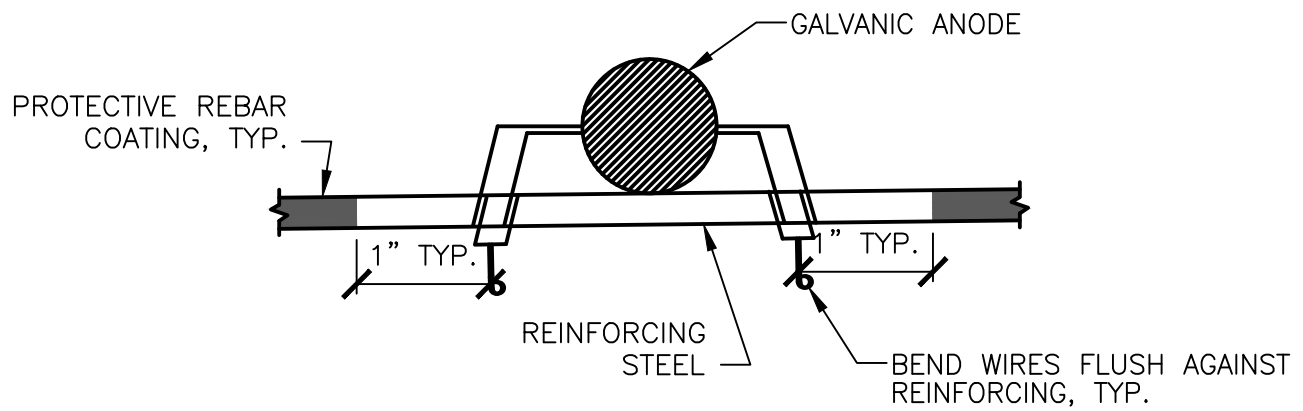

TYPICAL INSTALLATION TO SIDE REBAR

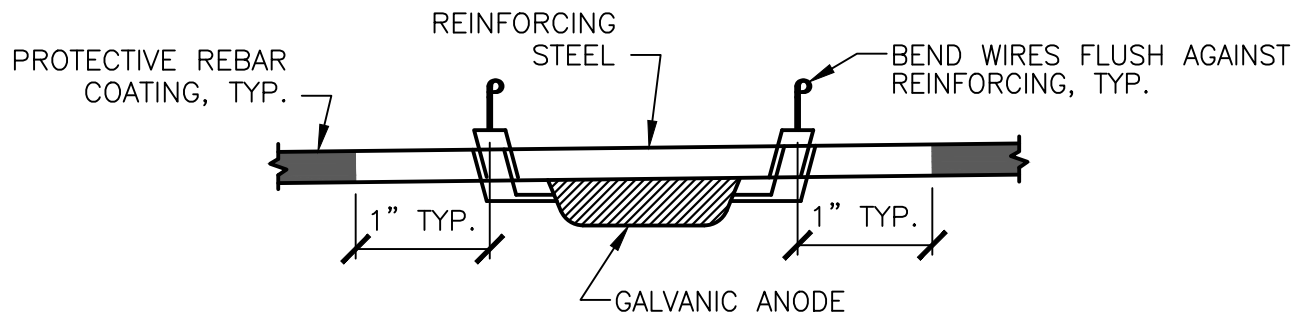

TYPICAL INSTALLATION ABOVE/BELOW REBAR

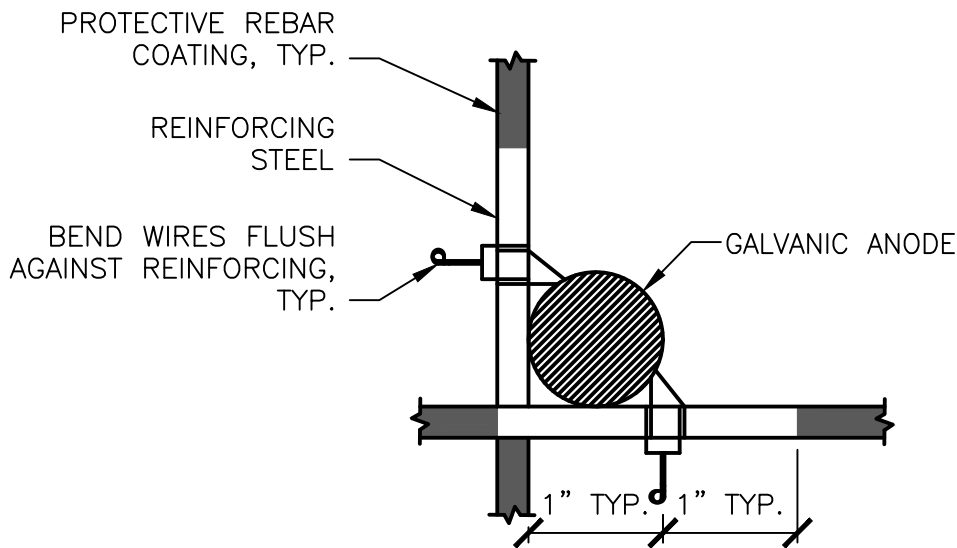

TYPICAL INSTALLATION AT REBAR INTERSECTION

NOTES:

1. GALVANIC ANODE SIZES AND SHAPES MAY VARY.

NOT TO SCALE



STANDARD DESIGN DETAIL

TYPICAL GALVANIC ANODE CONNECTIONS

DRAWING NO.


606

SHEET

1 OF 1

DATE

7/2025

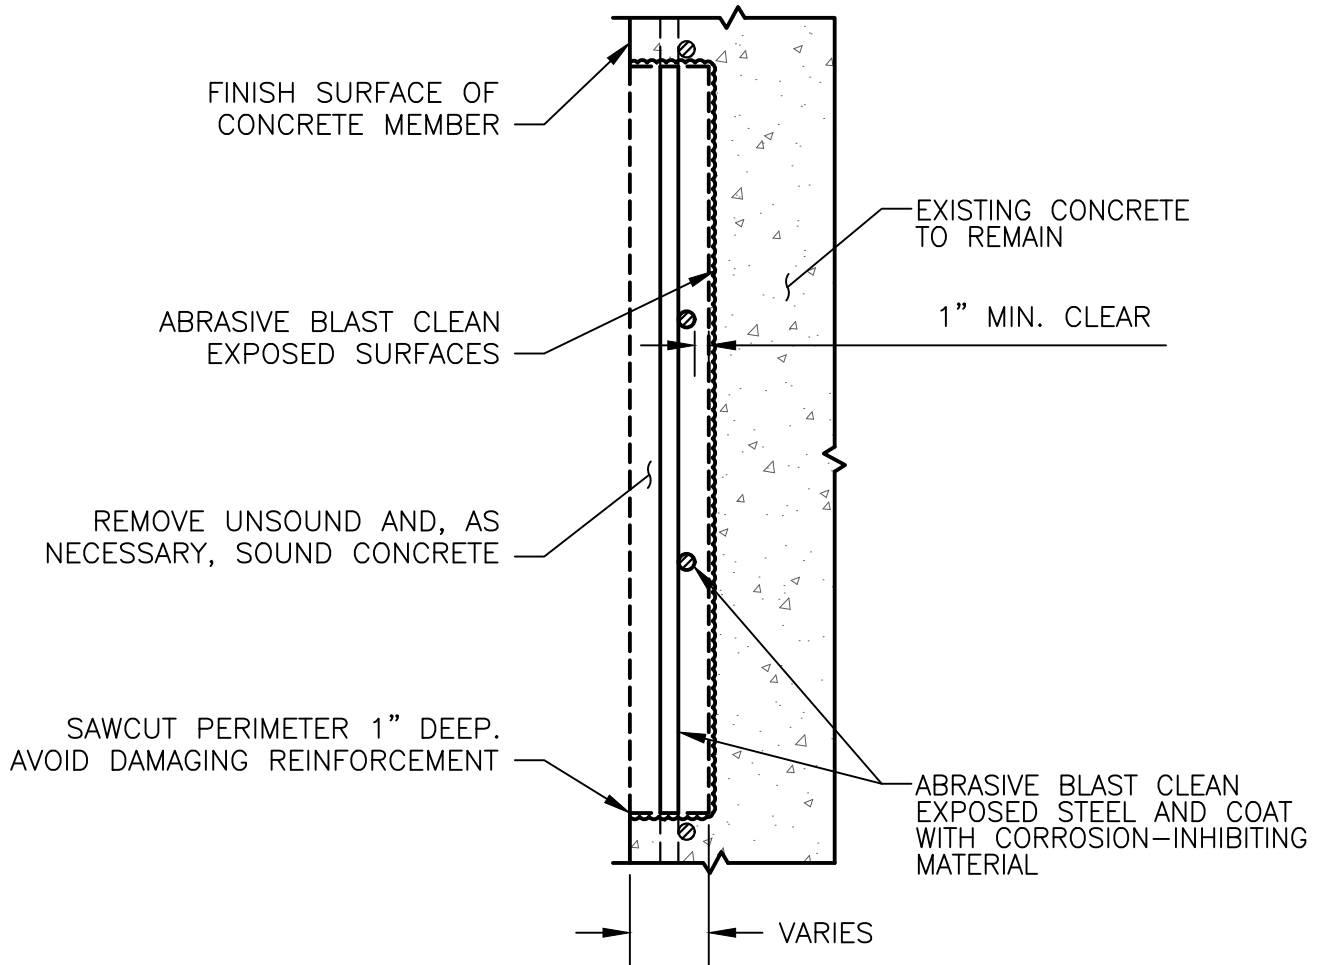

NOT TO SCALE



STANDARD DESIGN DETAIL

REMOVAL OF UNSOUND CONCRETE TYPICAL SECTION

DRAWING NO.


626

SHEET

1 OF 1

DATE

7/2025

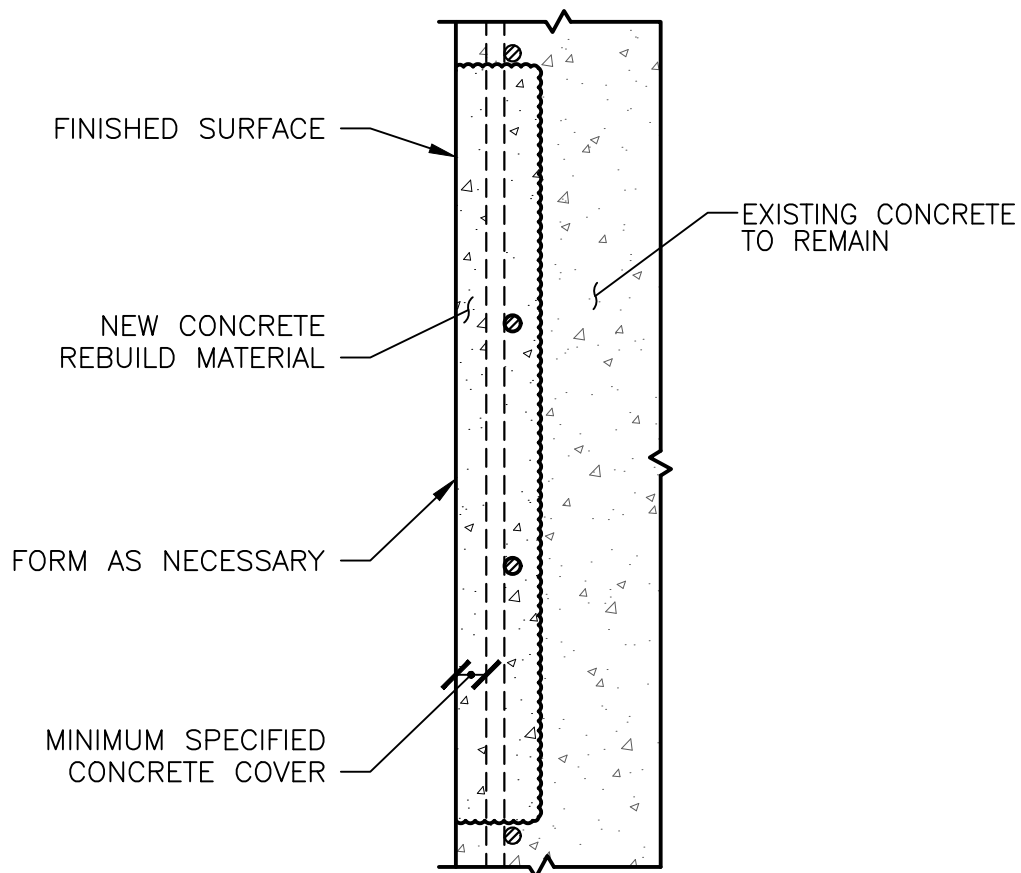

NOTES:

1. GALVANIC ANODES NOT SHOWN FOR CLARITY. REFER TO SPECIFICATION 03800 FOR REQUIREMENTS.

NOT TO SCALE



STANDARD DESIGN DETAIL

CONCRETE REBUILD
TYPICAL SECTION

DRAWING NO.


627

SHEET

1 OF 1

DATE

7/2025

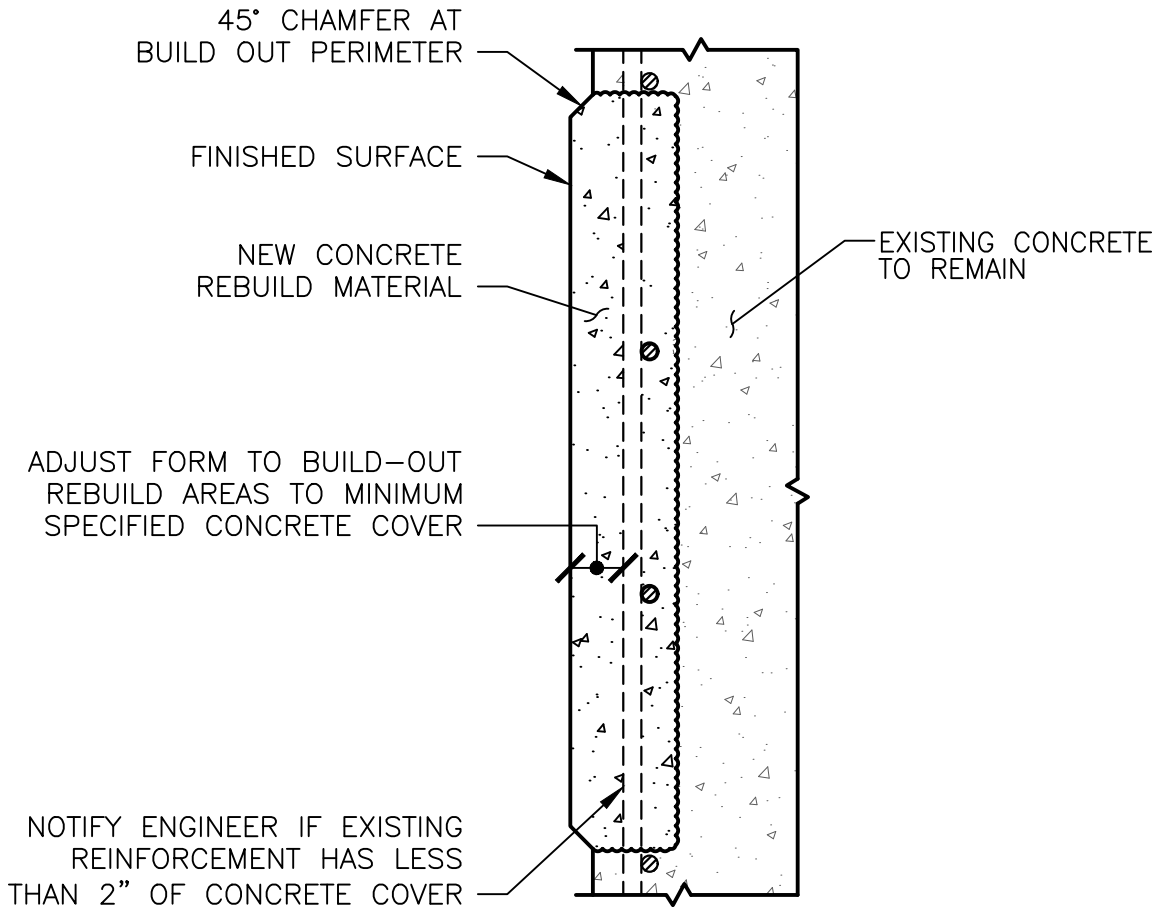

NOTES:

1. GALVANIC ANODES NOT SHOWN FOR CLARITY. REFER TO SPECIFICATION 03800 FOR REQUIREMENTS.

NOT TO SCALE



STANDARD DESIGN DETAIL

MINIMUM COVER CONCRETE REBUILD

DRAWING NO.


628

SHEET

1 OF 1

DATE

7/2025

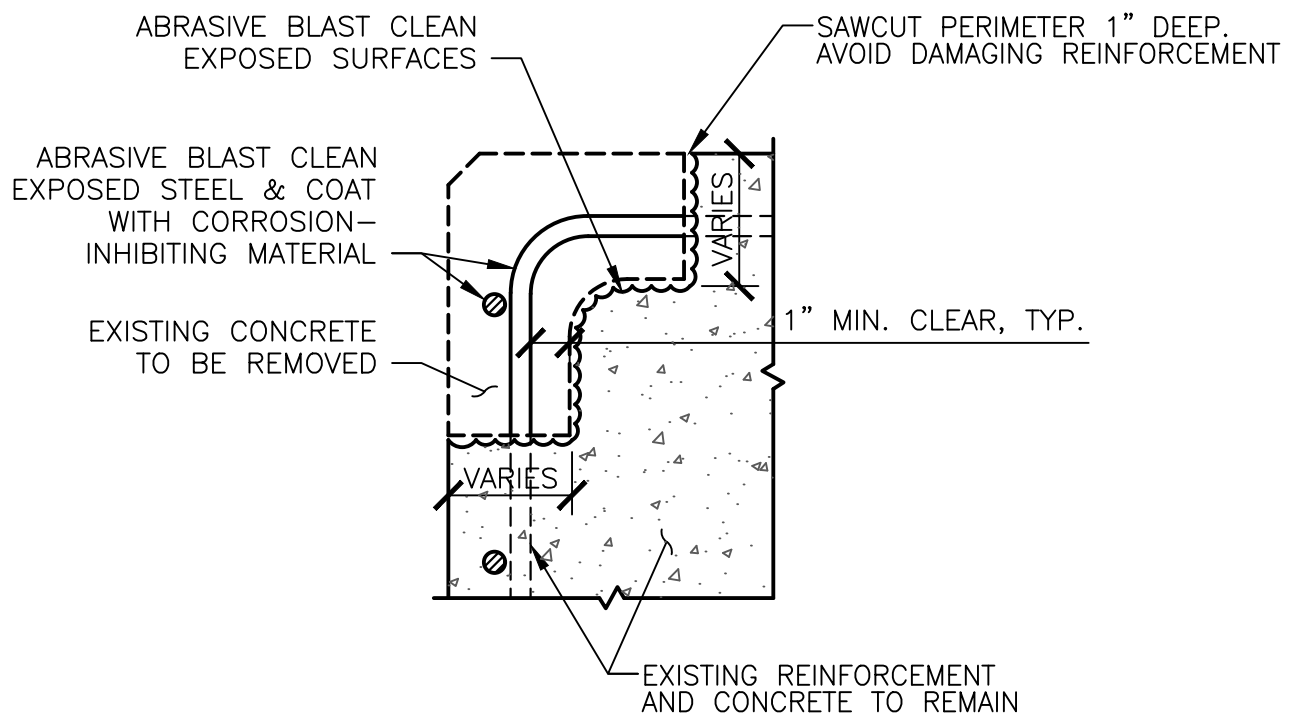

NOTES:

1. GALVANIC ANODES NOT SHOWN FOR CLARITY. REFER TO SPECIFICATION 03800 FOR REQUIREMENTS.

NOT TO SCALE



STANDARD DESIGN DETAIL

REMOVAL OF UNSOUND
CONCRETE CORNER SECTION

DRAWING NO.


629

SHEET

1 OF 1

DATE

7/2025

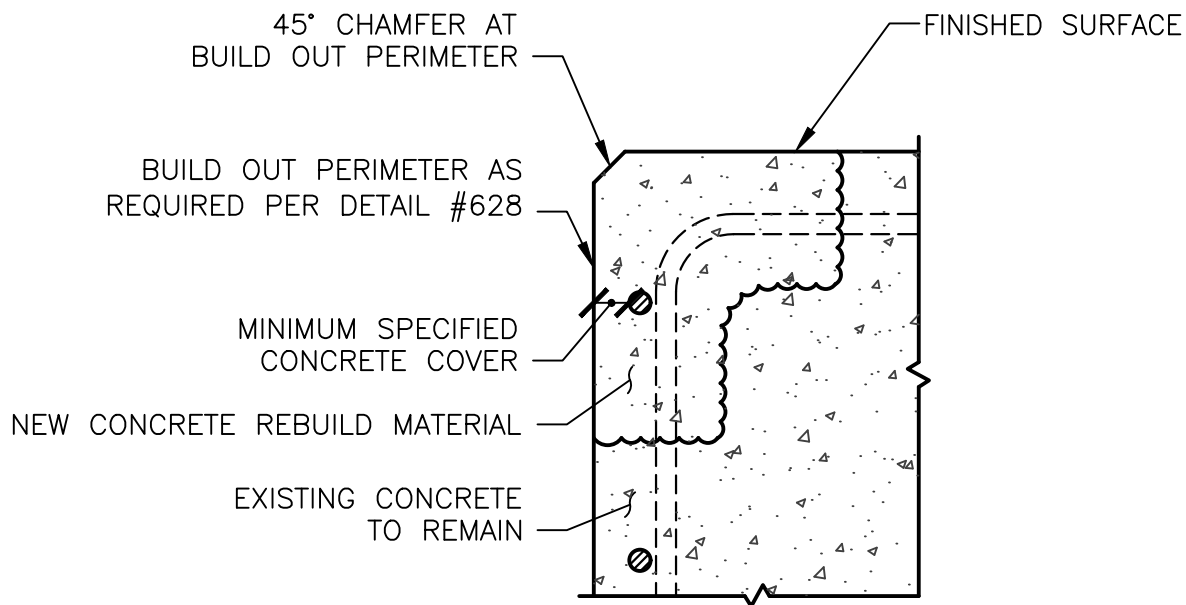

NOTES:

1. GALVANIC ANODES NOT SHOWN FOR CLARITY. REFER TO SPECIFICATION 03800 FOR REQUIREMENTS.

NOT TO SCALE



STANDARD DESIGN DETAIL

CONCRETE REBUILD
CORNER SECTION

DRAWING NO.
630

SHEET
1 OF 1


DATE
7/2025

10% SECTION LOSS

BAR NO.	DIAMETER IN.	AREA IN. ²	BAR DIAMETER WITH 10% SECTION LOSS (IN.)	
			CIRCUMFERENTIAL LOSS	ONE – SIDED LOSS
3	0.375	0.110	0.356	0.315
4	0.500	0.196	0.474	0.420
5	0.625	0.307	0.593	0.525
6	0.750	0.442	0.712	0.625
7	0.875	0.601	0.830	0.735
8	1.000	0.785	0.949	0.835
9	1.128	0.999	1.070	0.945
10	1.270	1.267	1.205	1.060
11	1.410	1.561	1.338	1.180



CIRCUMFERENTIAL LOSS



ONE – SIDED LOSS



STANDARD DESIGN DETAIL

REINFORCING SECTION LOSS TABLE

DRAWING NO.

631


SHEET

1 OF 1

DATE

7/2025

SUPPLEMENTAL REINFORCING
BAR TO MATCH EXISTING

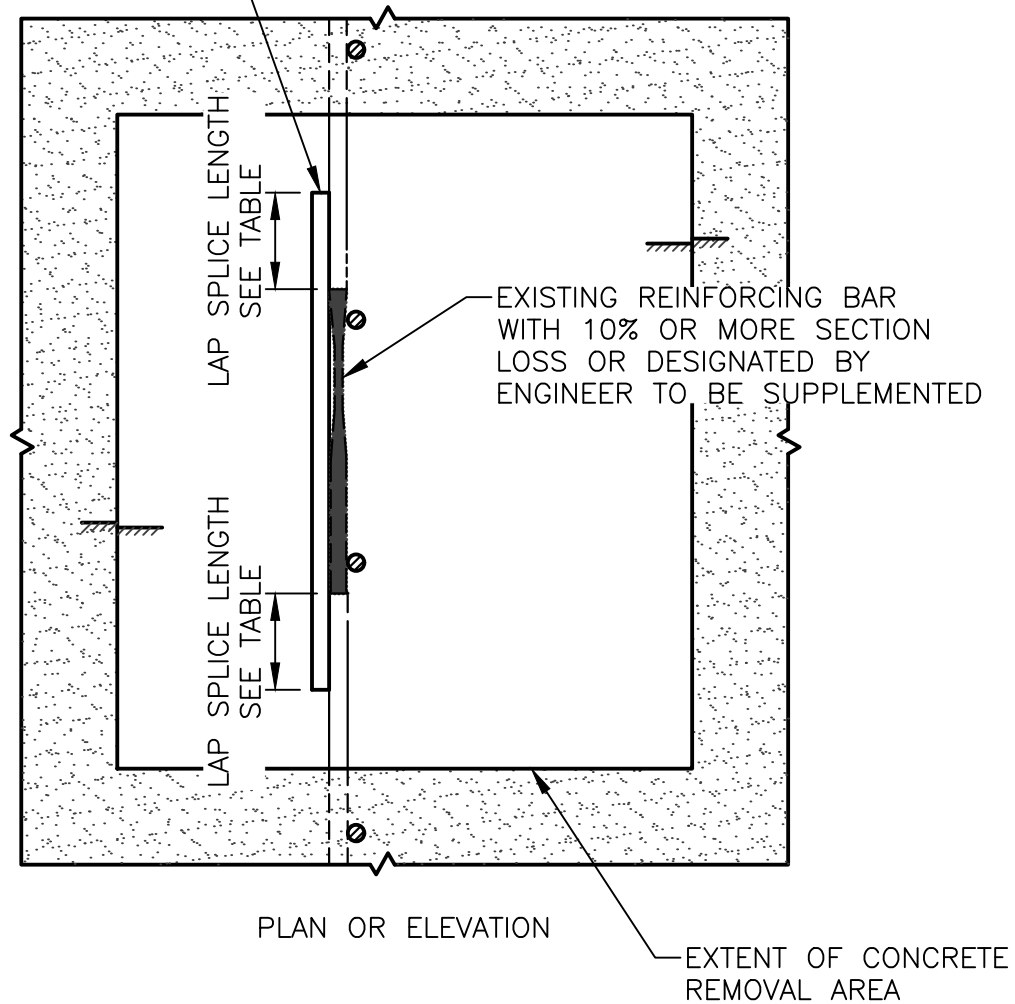

NOT TO SCALE



STANDARD DESIGN DETAIL

LAP SPLICE – OPTION 1

DRAWING NO.

632

SHEET

1 OF 1

DATE

7/2025

TENSION LAP LENGTH – CLASS B SPLICE – TOP & BOTTOM BARS
(GRADE 60 UNCOATED BARS & NORMAL WEIGHT CONCRETE)

BAR NO.	f _c =4,000PSI		f _c =5,000PSI	
	TOP	BOT	TOP	BOT
3	15"	12"	13"	12"
4	20"	15"	18"	14"
5	24"	19"	22"	17"
6	29"	22"	26"	20"
7	42"	33"	38"	29"
8	48"	37"	43"	33"
9	60"	46"	54"	41"
10	74"	57"	66"	51"
11	89"	68"	79"	61"

NOTES:

1. THIS TABLE IS BASED ON ACI 318-11, EQUATION 12-1 WITH A MINIMUM CLEAR COVER OF 2 INCHES AND MINIMUM CENTER-TO-CENTER BAR SPACING OF 5 INCHES.
2. "TOP" BARS ARE HORIZONTAL REINFORCING BARS WITH MORE THAN 12 INCHES OF FRESH CONCRETE CAST BELOW THE BARS AT THE DEVELOPMENT LENGTH. ALL OTHER BARS ARE CONSIDERED "BOT" BARS.
3. FOR EPOXY COATED OR ZINC AND EPOXY DUAL COATED BARS, MULTIPLY THE TABLE VALUES BY 1.5 FOR BOTTOM BARS, OR 1.3 FOR TOP BARS. IF THE CONCRETE COVER IS AT LEAST 3X THE BAR DIAMETER AND CLEAR SPACING AT LEAST 6X THE BAR DIAMETER, MULTIPLY VALUES BY 1.2.
4. FOR CLASS A SPLICE, DIVIDE VALUES BY 1.3.
5. FOR LIGHTWEIGHT CONCRETE, MULTIPLY VALUES BY 1.33.



STANDARD DESIGN DETAIL

LAP SPLICE LENGTHS – OPTION 1

DRAWING NO.


633

SHEET

1 OF 1

DATE

7/2025

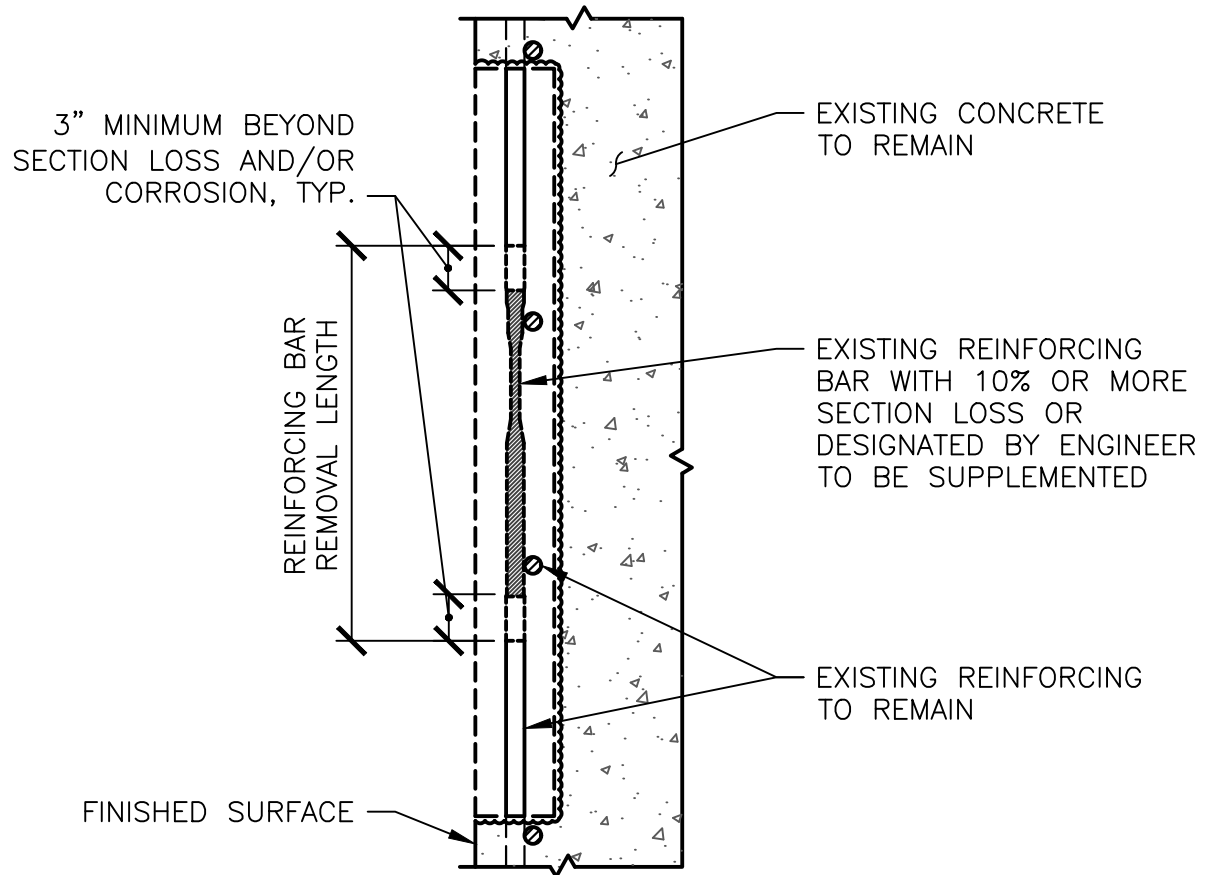

NOT TO SCALE



STANDARD DESIGN DETAIL

MECHANICAL SPLICE – OPTION 2 TYPICAL REMOVAL SECTION

DRAWING NO.


634

SHEET

1 OF 1

DATE

7/2025

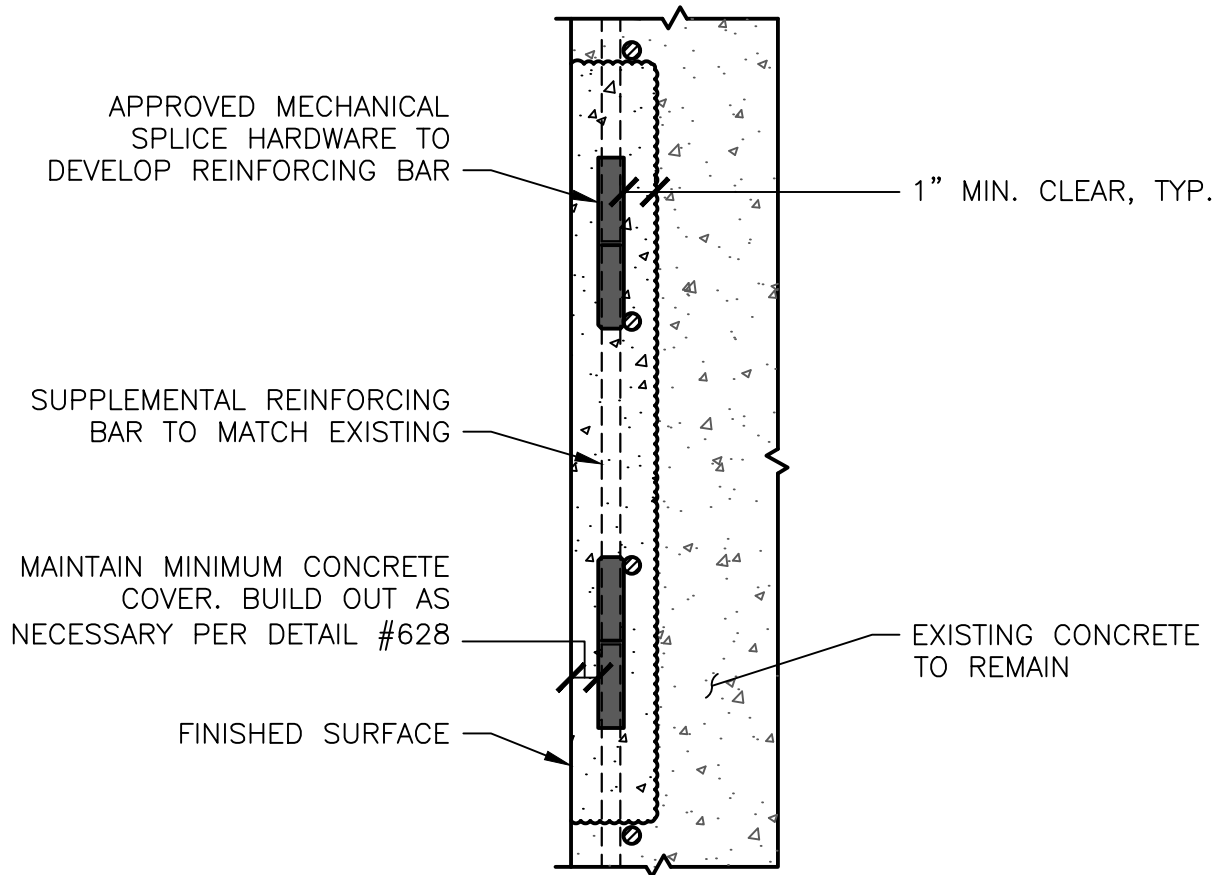

NOTES:

1. GALVANIC ANODES NOT SHOWN FOR CLARITY. REFER TO SPECIFICATION 03800 FOR REQUIREMENTS.

NOT TO SCALE




STANDARD DESIGN DETAIL

MECHANICAL SPLICE – OPTION 2
TYPICAL REBUILD SECTION

DRAWING NO.
635

SHEET
1 OF 1

DATE
7/2025

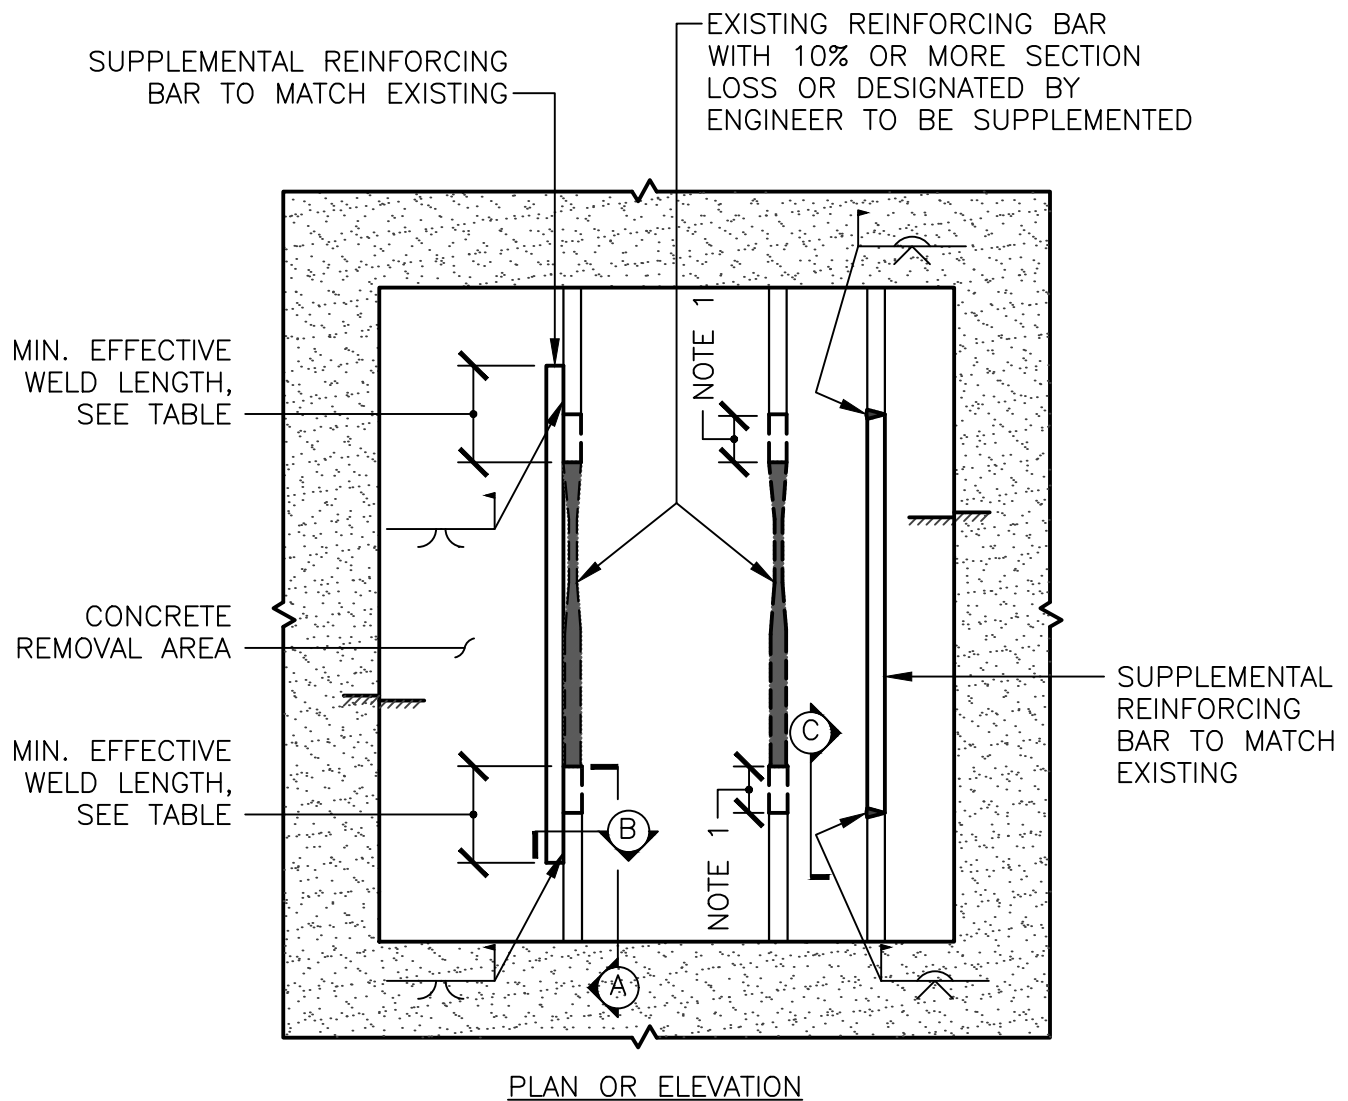

NOTE 1: CUT BAR 3 INCHES MINIMUM BEYOND SECTION LOSS AND/OR CORROSION AND REMOVE

NOTE 2: SEE DETAILS 637 & 638 FOR SECTIONS

NOTE 3: GALVANIC ANODES NOT SHOWN FOR CLARITY. REFER TO SPECIFICATION 03800 FOR REQUIREMENTS.

NOT TO SCALE



STANDARD DESIGN DETAIL

WELD SPLICE – OPTION 3

DRAWING NO.


636

SHEET


1 OF 1

DATE

7/2025

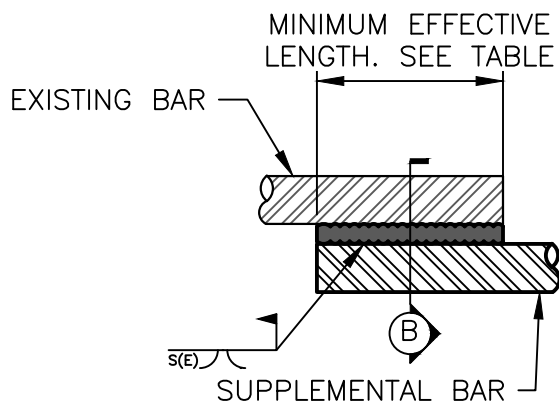

SECTION A – FLARE V – GROOVE WELD SPLICE

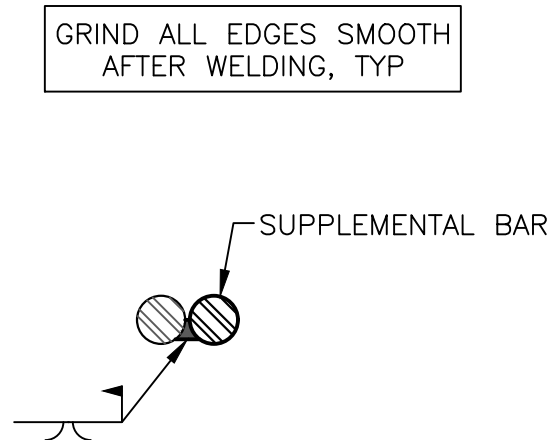

SECTION B

WELD SPLICE LENGTHS

BAR NO.	MINIMUM EFFECTIVE WELD LENGTH, in.	BAR RADIUS, S, in.
3	3.5	0.188
4	4.5	0.250
5	5.5	0.313
6	7.0	0.375
7	8.0	0.438
8	9.0	0.500
9	10.0	0.563
10	11.5	0.625
11	12.5	0.688

E-EFFECTIVE THROAT, 0.65
BASED ON E70XX ELECTRODES

NOT TO SCALE



STANDARD DESIGN DETAIL

WELD SPLICE DETAILS – OPTION 3

DRAWING NO.


637

SHEET

1 OF 1

DATE

7/2025

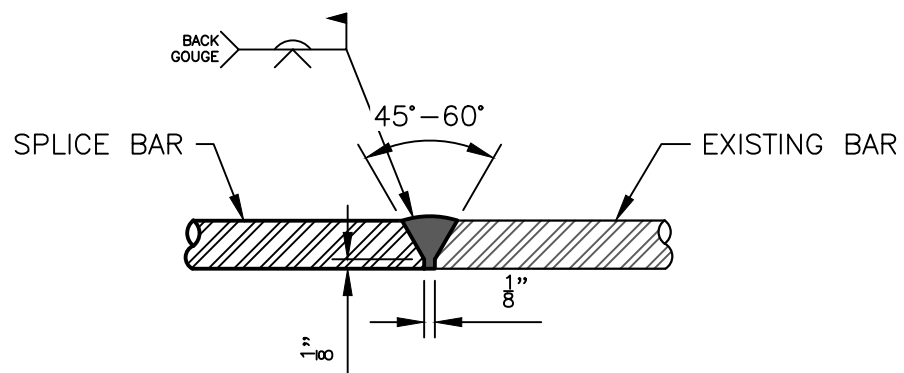

SECTION C – SINGLE V – GROOVE WELD SPLICE

NOT TO SCALE



STANDARD DESIGN DETAIL

WELD SPLICE DETAILS – OPTION 3

DRAWING NO.


638

SHEET

1 OF 1

DATE

7/2025

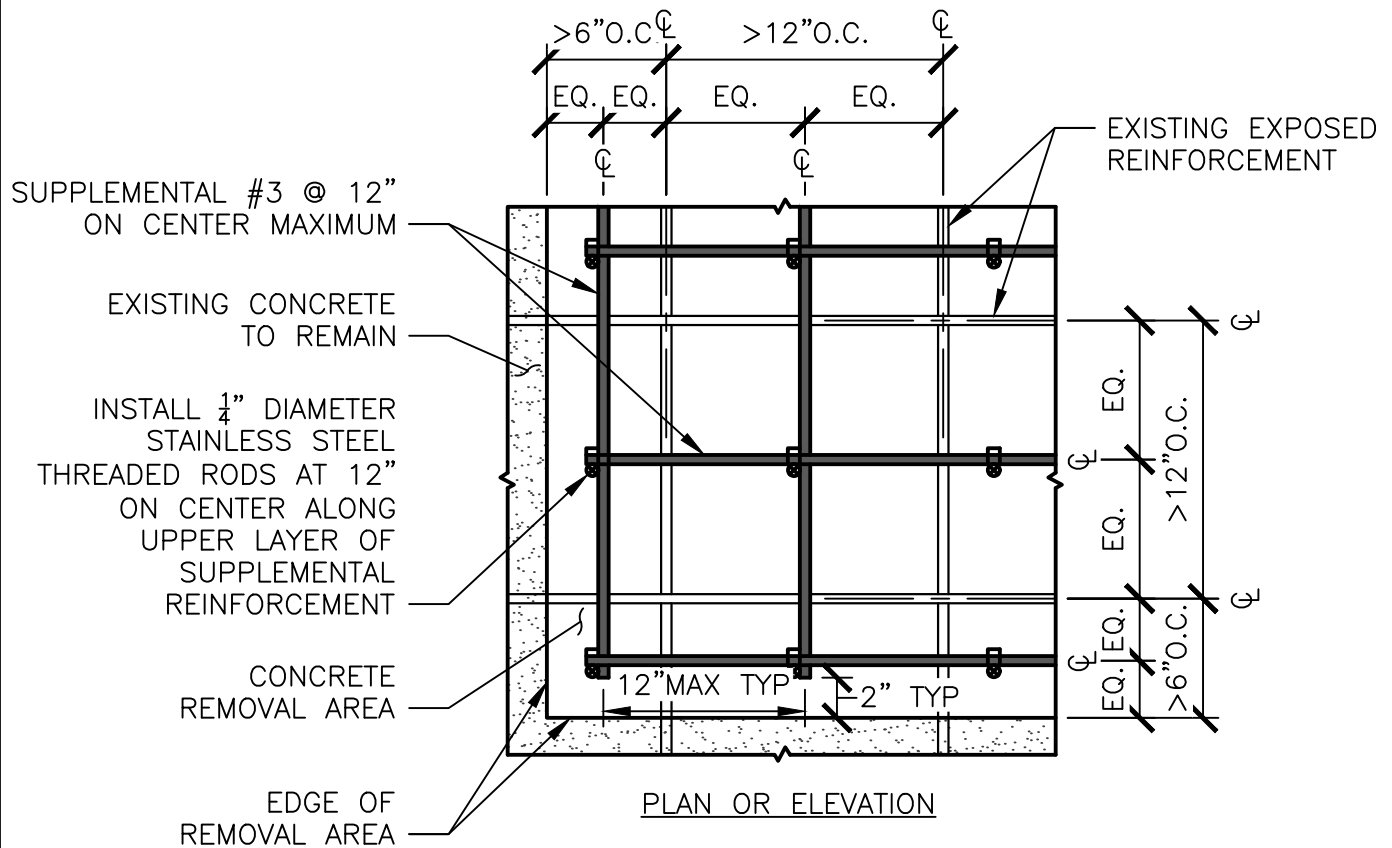

NOTES:

PROVIDE SUPPLEMENTAL REINFORCEMENT FOR EXISTING REINFORCEMENT THAT:

1. IS LOCATED 3" OR MORE BELOW NEW CONCRETE SURFACE; OR
2. HAS PROVIDED 2" MINIMUM CLEAR COVER, BUT SPACED GREATER THAN 12" O.C.
3. IS LOCATED 6" OR MORE FROM EXISTING CONCRETE TO REMAIN.

NOT TO SCALE



STANDARD DESIGN DETAIL

SUPPLEMENTAL REINFORCEMENT REQUIREMENTS

DRAWING NO.


639

SHEET


1 OF 1

DATE

7/2025

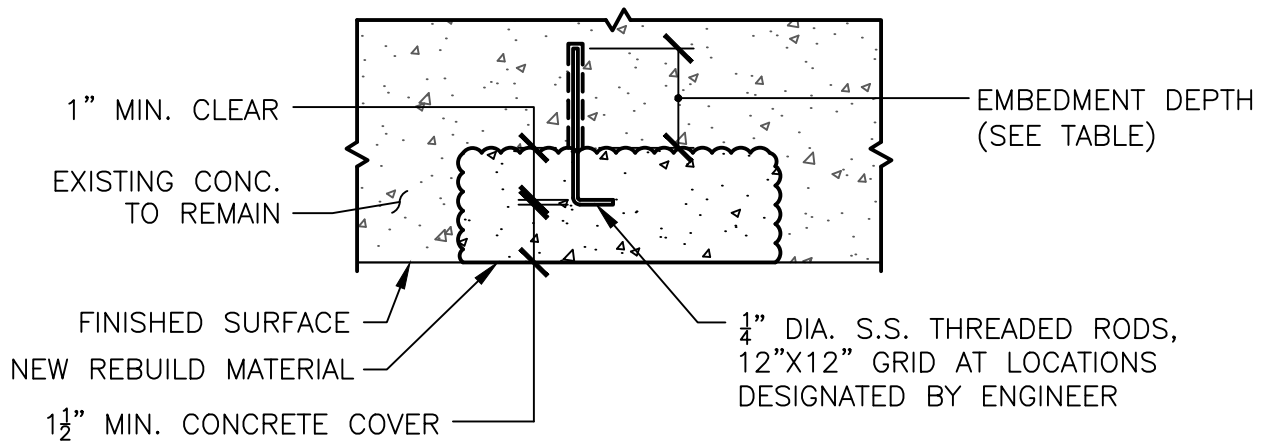

TYPICAL SECTION AT CONC. REMOVAL AREAS – VERTICAL AND OVERHEAD SURFACES

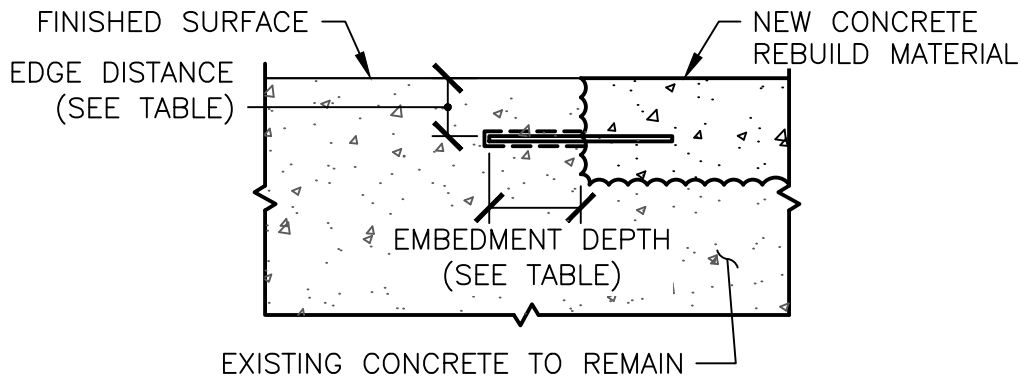

ADHESIVE-GROUTED DOWEL LAYOUT DIMENSIONS

DOWEL SIZE	ALLOWABLE TENSION LOAD PER ANCHOR, lbs	MINIMUM EMBEDMENT DEPTH, in.	MINIMUM CONCRETE THICKNESS, in.	MINIMUM EDGE DISTANCE, in.	MINIMUM SPACING, in.
1/4"Ø	950	3	6	4.0	8.0
#3	2,100	4	6	6.0	12.0
#4	2,800	4	6	6.0	12.0

NOTES:

1. TABLE VALUES FOR SINGLE ANCHORS IN TENSION ONLY; REINFORCING STEEL YIELD STRENGTH OF 60 KSI; THREADED RODS A276, TYPE 316, YIELD STRENGTH OF 30 KSI; HILTI HIT-HY 200 OR HILTI HIT-RE 500 V3 ADHESIVE, 4,000 PSI CONCRETE.

2. IF CONDITIONS ARE DIFFERENT THAN THOSE LISTED ABOVE, TABLE VALUES SHALL BE ADJUSTED BY A LICENSED PROFESSIONAL ENGINEER BASED ON ACTUAL DOWEL SYSTEM USED AND REQUIRED DOWEL CAPACITY.

NOT TO SCALE



STANDARD DESIGN DETAIL

ADHESIVE-GROUTED DOWEL LAYOUT

DRAWING NO.
640


SHEET
1 OF 1

DATE
7/2025

DO NOT EXTEND
DEMOLITION BEHIND
EMBED PLATE GREATER
THAN 1" WITHOUT
APPROVAL OF ENGINEER

EXISTING CONCRETE
TO REMAIN

NEW CONCRETE
REBUILD MATERIAL

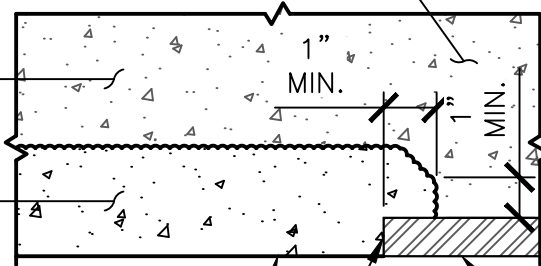

FINISHED SURFACE

EXISTING EMBED PLATE

EXTEND DEMOLITION & REBUILD
1" BEHIND EMBED PLATE; CLEAN
PLATE SURFACES & COAT W/
CORROSION-INHIBITING MATERIAL

REINF. NOT SHOWN FOR CLARITY,
REF. DETAILS 626 - 628
FOR REQUIREMENTS NOT
OTHERWISE SHOWN

NOT TO SCALE



STANDARD DESIGN DETAIL

CONCRETE REBUILD
EMBED PLATE

DRAWING NO.

641


SHEET

1 OF 1


DATE

7/2025

DEMOLITION IS
TYP. AT HORIZ. &
VERT. LOCATIONS

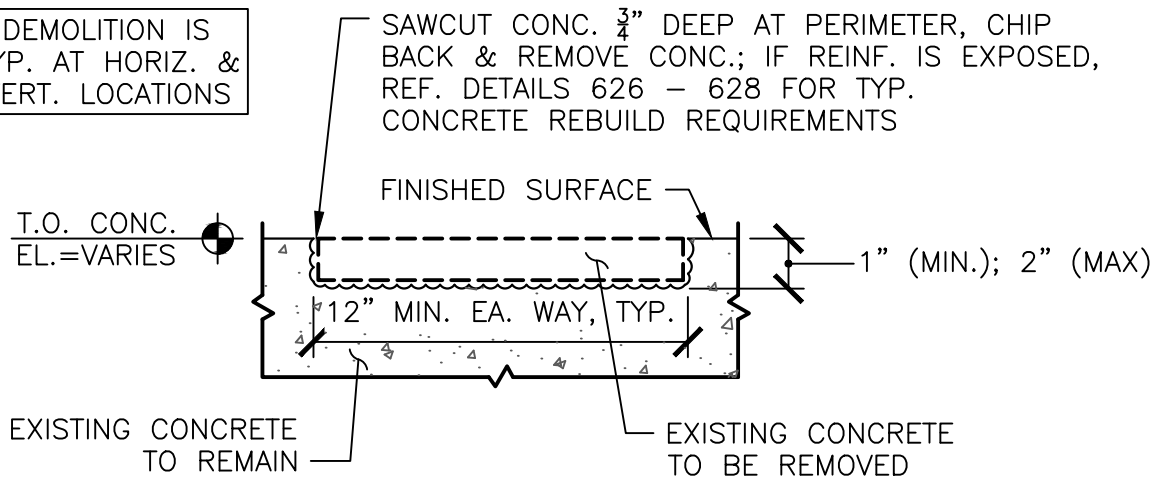

DEMOLITION

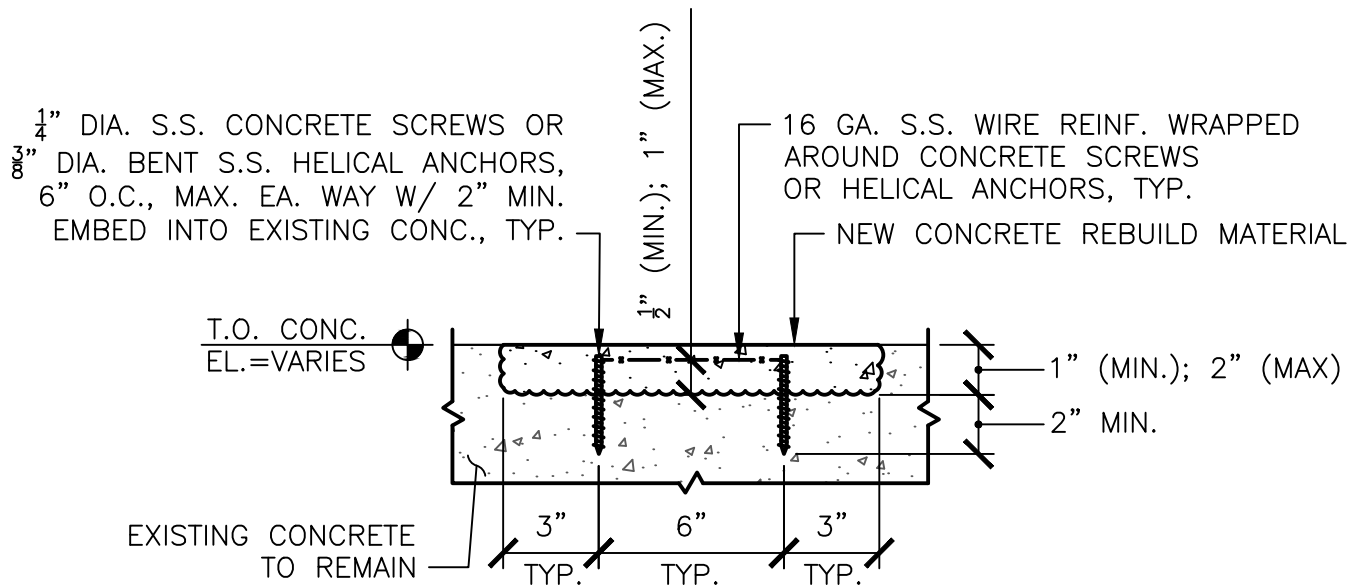

SHALLOW CONCRETE REBUILD - HORIZONTAL

NOT TO SCALE



STANDARD DESIGN DETAIL

HORIZONTAL SHALLOW DEPTH
(2"MAX) CONCRETE REBUILD

DRAWING NO.

642


SHEET

1 OF 1

DATE

7/2025

REF. DETAIL #642 FOR
TYPICAL DEMOLITION
REQUIREMENTS

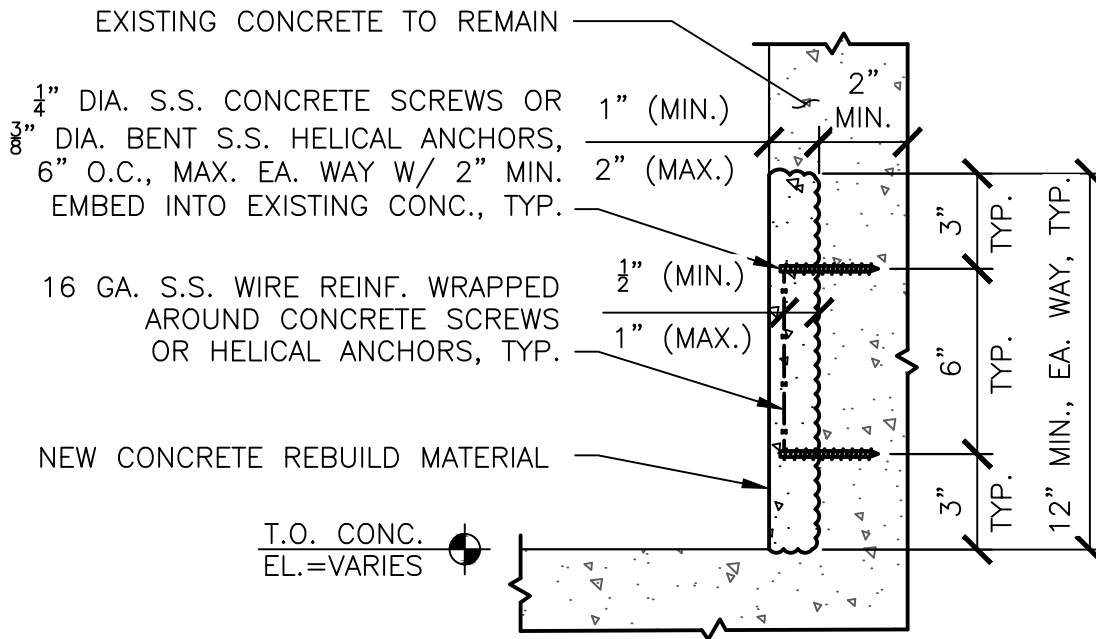

SHALLOW CONCRETE REBUILD – VERTICAL

NOT TO SCALE



STANDARD DESIGN DETAIL

VERTICAL SHALLOW DEPTH
(2" MAX) CONCRETE REBUILD

DRAWING NO.


643

SHEET

1 OF 1


DATE

7/2025

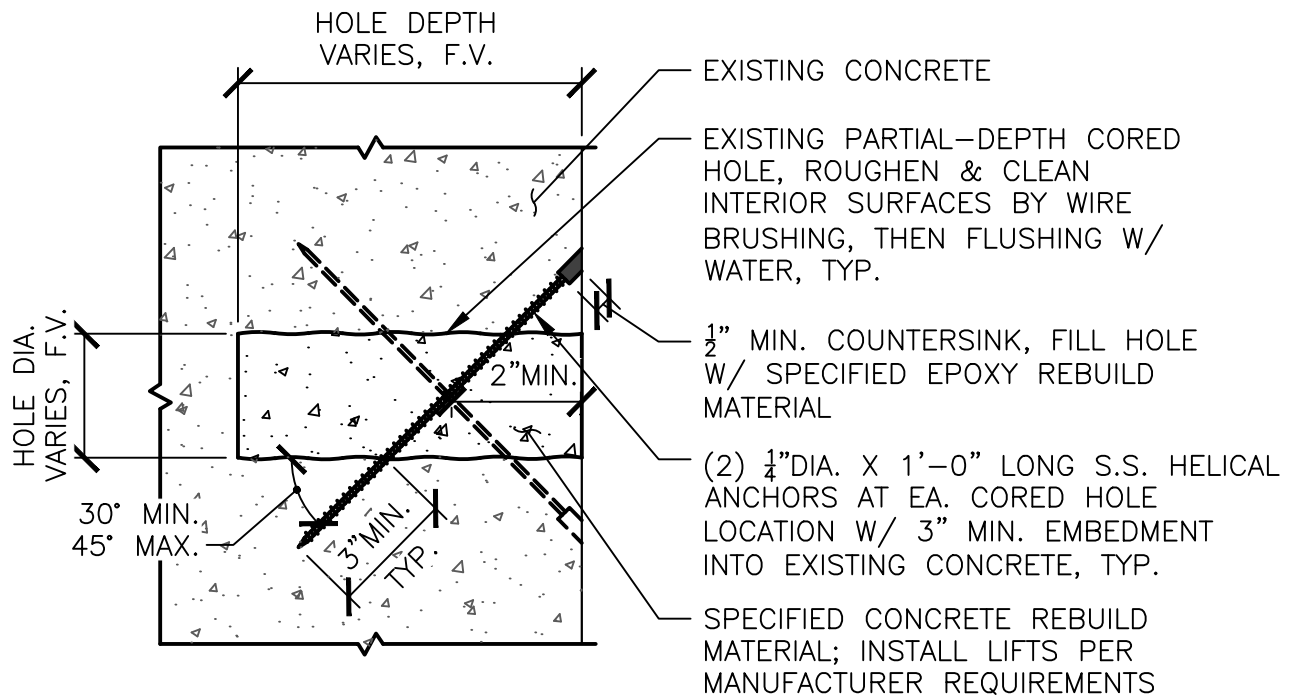

REBUILD SECTION

INSTALL ANCHORS AROUND PERIMETER OF CORED HOLE PER FIGURE BELOW, TYP.

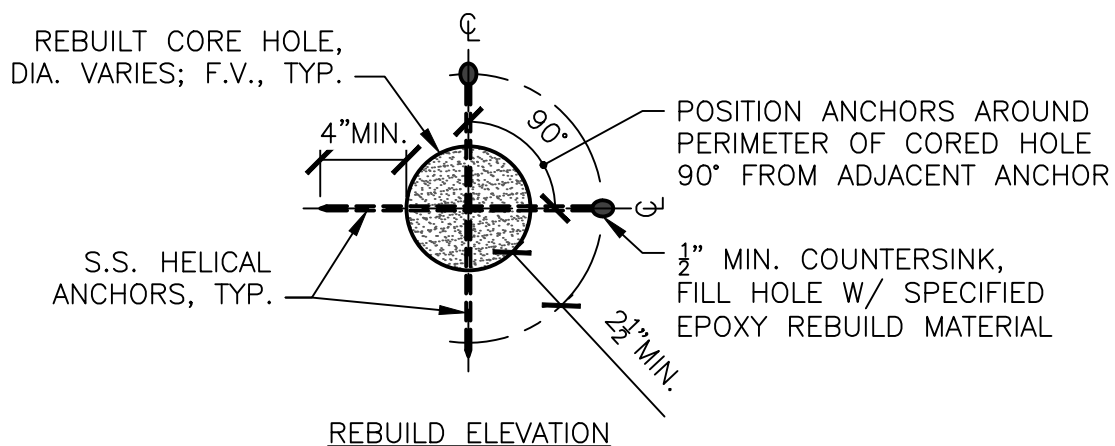

NOT TO SCALE



STANDARD DESIGN DETAIL

PARTIAL DEPTH CONCRETE
REBUILD CORE HOLE

DRAWING NO.


644

SHEET

1 OF 1

DATE

7/2025

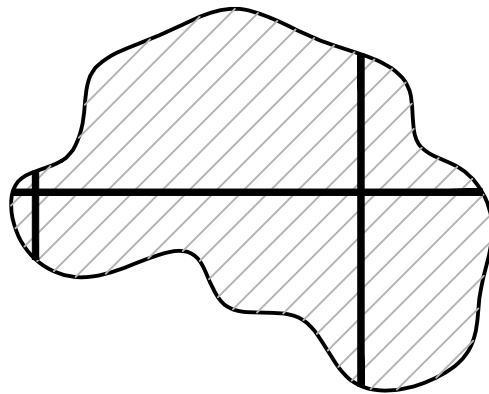

SEE DETAIL 646B FOR SECTION VIEW AND NOTES

NOT TO SCALE



STANDARD DESIGN DETAIL

SPALL REPAIR WITH
EXPOSED REINFORCING STEEL

DRAWING NO.


646A

SHEET

1 OF 2

DATE

7/2025

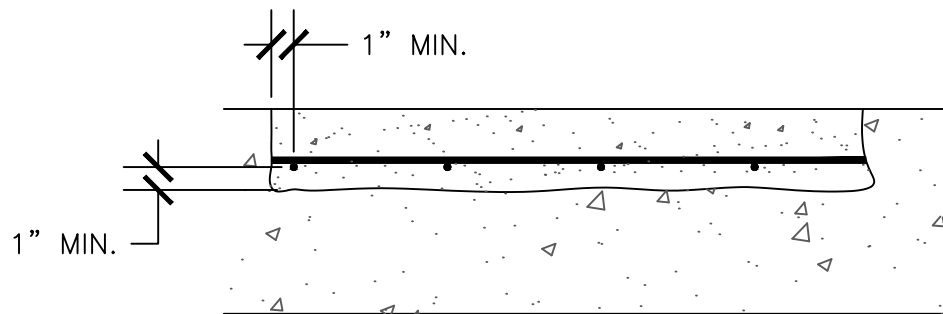

NOTES:

1. IF SECTION LOSS OF REBAR IN A MEMBER (SLAB AREA, BEAM OR COLUMN) EXCEEDS 25% THIS REPAIR SHALL BE REVIEWED BY A STRUCTURAL ENGINEER.
2. WATER BLAST OR SAND BLAST EXPOSED CONCRETE AND REBAR (SSPC5 WHITE METAL BLAST) IN SPALLED AREA.
3. CHIP OUT CONCRETE AROUND EXISTING REBAR TO LEAVE A ONE INCH SPACE (MIN.) BETWEEN REBAR AND CONCRETE. CHIP BACK FURTHER IF NECESSARY TO ACHIEVE SOUND CONCRETE.
4. ROUGHEN CONCRETE SURFACE, CLEAN DEBRIS AND DIRT FROM REPAIR AREA, COAT REBAR WITH CORROSION INHIBITOR. WET CONCRETE SURFACE PRIOR TO PLACING NEW CONCRETE.
5. CORROSION INHIBITOR SHALL MEET REQUIREMENT OF ASTM C1582.
6. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF (f'_c) 5000 psi AT AN AGE OF 28 DAYS. MAXIMUM WATER-CEMENT RATIO (W/C) SHALL BE 40% BY WEIGHT. CEMENT SHALL BE ASTM C150 TYPE II WITH A MAXIMUM OF 0.6% ALKALIS BY WEIGHT. CONCRETE SHALL CONTAIN 7% SILICA FUME OR 15% FLYASH AS WEIGHT PERCENT OF CEMENTITIOUS MATERIALS.



STANDARD DESIGN DETAIL

SPALL REPAIR WITH
EXPOSED REINFORCING STEEL

DRAWING NO.


646B

SHEET


2 OF 2

DATE

7/2025

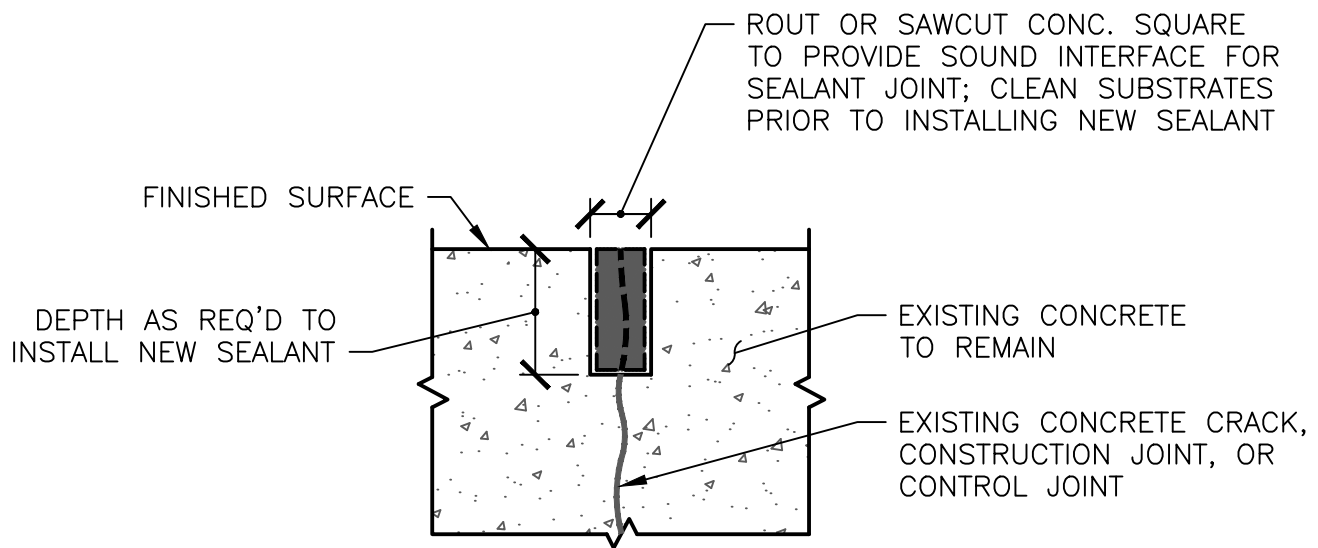

CONCRETE REMOVAL & SURFACE PREPARATION

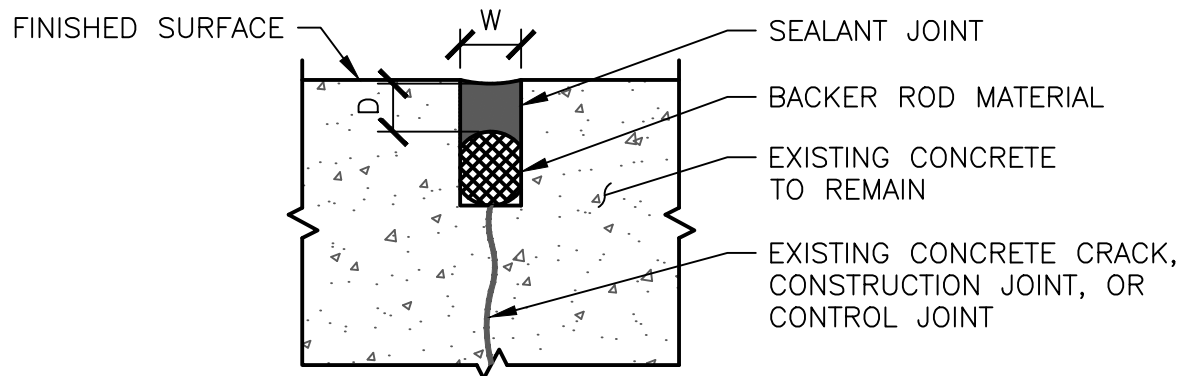

SEALANT JOINT INSTALLATION

HORIZONTAL SEALANT JOINT NOTES

1. IF $W < \frac{1}{2}$ "; $D = W$; $\frac{1}{4}$ " MIN.
2. IF $W > \frac{1}{2}$ " TO 1"; $D = (\frac{1}{2})W$
3. IF $W > 1$ "; $D = \frac{1}{2}$ "
4. ENSURE BACKER ROD DIA. IS 25%(±) LARGER THAN WIDTH OF THE JOINT, TYP.

NOT TO SCALE



STANDARD DESIGN DETAIL

JOINT SEALANT

DRAWING NO.

651

SHEET

1 OF 1

DATE

7/2025