

HRSD SWIFT Research Center (SRC) Quarterly Report on SWIFT Water Quality Targets

This report documents SWIFT Water Quality results for recharge operations from January 1 – March 31, 2022. Recharge operations ceased in early November to accommodate activities associated with installation of the new recharge well as described later in this report. The compliance requirements are documented in HRSD’s SWIFT Underground Injection Control Inventory Information Package (UIC-IIP) submitted to EPA Region III in January 2018. These requirements are noted in Tables 1-4 and reflect an update to the monitoring and compliance evaluation for Total coliform.

Figures 1 and 2 and Table 6 provide a summary of the data from the referenced quarter of operations relative to the SWIFT Water Quality Targets. Table 6 represents a summary of all analytes that were present above the laboratory reporting limit. A detailed table identifying the parameters monitored for the purpose of evaluating compliance with the SWIFT Water Quality Targets can be found as an Appendix to this report.

Parameter	Proposed Regulatory Limit	Non-Regulatory Action/Goal
EPA Drinking Water Primary Maximum Contaminant Levels (MCLs)	Meet all primary MCLs	N/A
Total Nitrogen	5 mg/L Monthly Average; 8 mg/L Max Daily	Secondary Effluent Critical Control Point (CCP) Action Limit for Total Inorganic Nitrogen (TIN) = 5 mg/L-N; CCP Action Limit for SWIFT Water Total Nitrogen (TN) = 5 mg/L-N
Turbidity	Individual Filter Effluent (IFE) < 0.15 NTU 95% of time and never >0.3 NTU in two consecutive 15 min measurements	CCP Action Limit IFE of 0.15 NTU to initiate backwash or place a filter in standby
Total Organic Carbon (TOC) ¹	4 mg/L Monthly Average; 6 mg/L Maximum Daily	Critical Operating Point (COP) Action Limit to Initiate GAC Regeneration
Total Coliform ²	<2 CFU/100 mL for 95% of calendar month observations, applied as the 95 th percentile	N/A
E.coli	Non-detect	N/A
TDS ³	N/A	Monitor PAS Compatibility

Table 1: SRC Regulatory and Monitoring Limits for SWIFT Water

¹ Regulatory limit applies to the TOC laboratory analysis which is collected at a minimum frequency of 3 times per week.

² The Total Coliform (TC) monitoring and compliance evaluation reflects an update effective in January 2020 following consultation with the Virginia Department of Health and EPA Region III UIC staff.

³ No limit for Total Dissolved Solids (TDS) proposed as the primary driver is aquifer compatibility. The concentration of TDS in SWIFT Water at the SRC generally ranges from 500-850 mg/L.

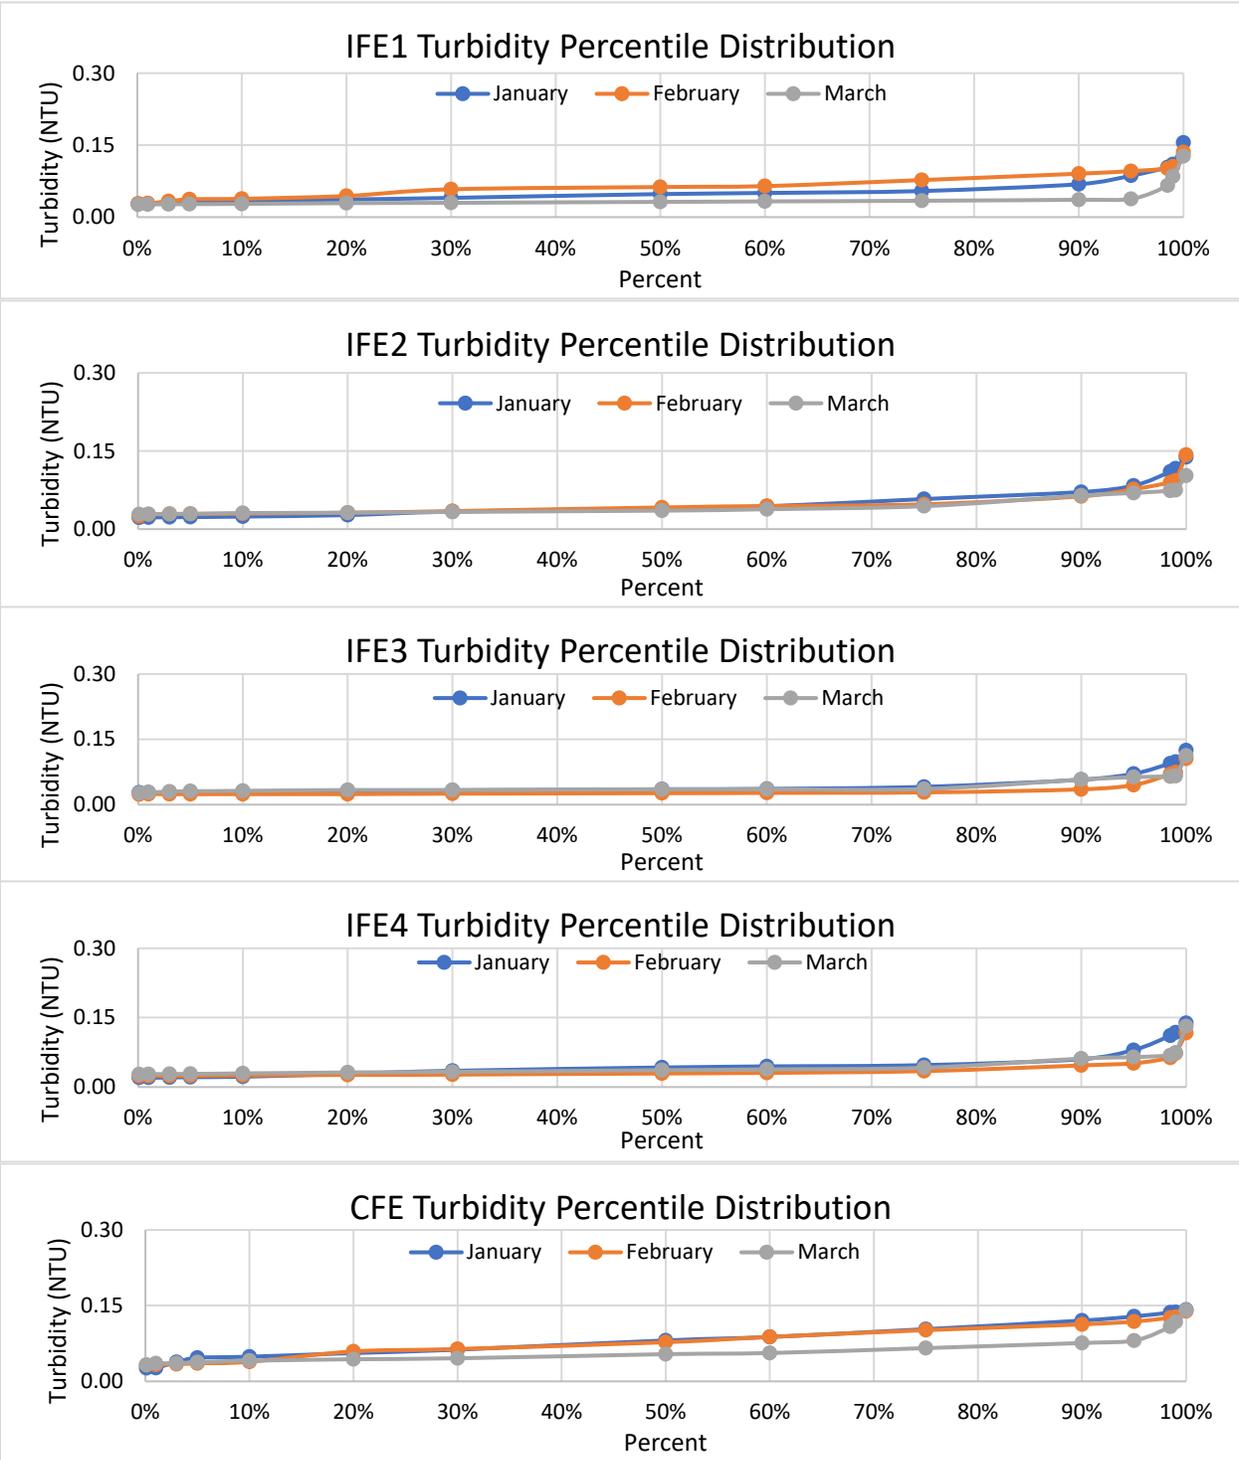


Figure 1: Percentile distribution of 15-minute average Individual Filter Effluent (IFE) Turbidities for Biofilters 1-4 (IFE1-4) and Biofilter Combined Filter Effluent (CFE). There were no 15-minute periods in this quarter with biofilter effluent turbidity values greater than 0.3 NTU. The 95% measured value for each biofilter IFE and the CFE was less than 0.15 NTU for each month in this quarter.

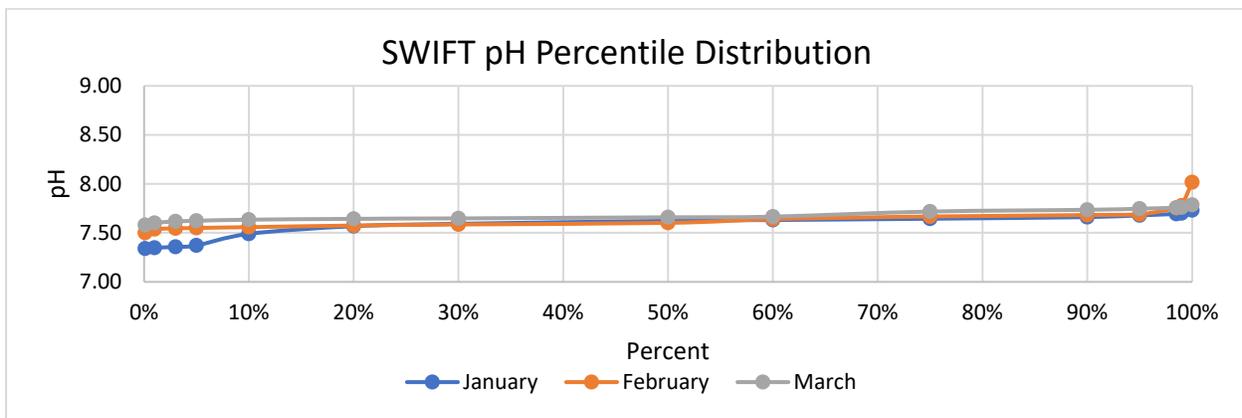


Figure 2: Distribution of Monthly SWIFT Water pH values.

Monitoring at the SRC also includes monitoring for performance indicators as documented in Table 2.

Constituent	Category	Trigger Value	Unit	Notes
1,4-Dioxane	Public Health	1	µg/L	CCL4; CA Notification Limit
17-β-Estradiol	Public Health	0.9 ¹	ng/L	CCL4
DEET	Public Health	200	µg/L	MN Health Guidance Value
Ethinyl Estradiol	Public Health	280 ¹	ng/L	CCL4
NDMA	Public Health	10	ng/L	CCL4; CA Notification Limit
Perchlorate	Public Health	6	µg/L	CA Notification Limit
PFOA+PFOS	Public Health	70	ng/L	CCL4; EPA Health Advisory
TCEP	Public Health	5	µg/L	MN Health Guidance Value
Cotinine	Treatment Effectiveness	1	µg/L	Surrogate for low molecular weight, partially charged cyclics
Primidone	Treatment Effectiveness	10	µg/L	
Phenytoin	Treatment Effectiveness	2	µg/L	
Meprobamate	Treatment Effectiveness	200	µg/L	High occurrence in wastewater treatment plant effluent
Atenolol	Treatment Effectiveness	4	µg/L	
Carbamazepine	Treatment Effectiveness	10	µg/L	Unique structure
Estrone	Treatment Effectiveness	320	ng/L	Surrogate for steroids
Sucralose	Treatment Effectiveness	150	mg/L	Surrogate for water soluble, uncharged chemicals with moderate molecular weight
Triclosan	Treatment Effectiveness	2,100	µg/L	Chemical of interest

¹ Identified as “To Be Determined” in the UIC-IIP. Since that time, threshold values were identified in *Monitoring Strategies for Constituents of Emerging Concern (CECs) in Recycled Water, Recommendations of a Science Advisory Panel, 2018; SCCWRP Technical Report 1032.*

Table 2: SRC Non-Regulatory Performance Indicators

Pathogen Log Removal Value (LRV) is not strictly regulated but the SRC has been

designed and is operated to achieve at least 12 LRV for viruses and 10 LRV for *Cryptosporidium* and *Giardia* through a combination of advanced treatment processes and soil aquifer treatment. Table 3 provides a treatment process pathogen LRV summary for recharge conditions. Table 4 provides additional monitoring that is being completed to document compliance with the LRVs for ozone and UV.

Parameter	Floc/Sed (+BAC)	Ozone	BAC+GAC	UV	Cl2	SAT	Total
Enteric Viruses	2	0-3 (TBD)	0	4	0-4	6	12-19
<i>Cryptosporidium</i>	4	0	0	6	0	6	16
<i>Giardia</i>	2.5	0-1.5 (TBD)	0	6	0	6	14.5-16

Table 3: SRC Pathogen LRV for Potomac Aquifer System (PAS) Recharge.

Ozone LRV
Ozone Influent Temperature
Ozone Influent Flow
Liquid Phase Ozone Concentration ¹
Contact Time
CT
UV LRV
UV Intensity, each reactor
UVT, GAC Combined Effluent
Reactor Flow, each
Calculated Dose, each Lamp
Status, each

¹ The ozone liquid phase probe is verified with lab grab samples performed at least once per week.

Table 4: Additional Monitoring to Support Ozone and UV LRV. All data are collected as continuous measurements. The 15-minute LRV data is submitted in Table 6.

Critical Control Points

The SRC incorporates Critical Control Points (CCP) throughout the treatment process, per Attachment G of UIC-IIP, to verify that treatment goals are being met at each of the individual processes. A violation of any CCP means that the SRC may not be producing water that meets the treatment goals and will trigger a diversion of the SWIFT Water so that it is not directed to the recharge well. In most instances, the SRC will continue to operate through the CCP violation, but the SWIFT Water will be diverted back to the Nansmond Plant chlorine contact tanks (CCT).

CCPs have alert values at which point the operator is expected to take action to correct the performance as well as the alarm values at which point an automated response will trigger action and prevent flow from going to the recharge well. Both the alert and alarm values will be measured consistently for a specified duration

before action is taken so that blips in online analyzers do not trigger action. The specific values for the alert and alarm levels will be configured as adjustable set points in the Distributed Control System (DCS) and optimized as needed to meet the water quality requirements.

Table 5 shows the current CCPs in effect at the SRC. Modifications have been made to the CCPs since startup as compared to the original design documents in order to optimize their performance. No modifications to the CCPs were made this quarter. Each of the modifications from previous quarters was discussed in the relevant quarterly report for the period.

Parameter	Alert Value	Alarm Value	Unit	Action
Critical Control Points (CCPs)				
Influent Pump Station Conductivity	1,400	1,600	microSiemens per centimeter	Place Biofilters in Filter To Waste
Influent Pump Station Total Inorganic Nitrogen	4.0	5.0	mg/L-N	Place Biofilters in Filter To Waste
Influent Pump Station Turbidity	3.5	5.0	NTU	Place Biofilters in Filter To Waste
Preformed Chloramine Failure on Injection	N/A	Failure	mg/L	Divert SWIFT Water
Total Chlorine Post Injection upstream of ozone	2.0	1.0	mg/L	Divert SWIFT Water
Chloramine injection upstream of ozone	2.0	1.0	mg/L	Divert SWIFT Water
Ozone Feed	N/A	Failure	N/A	Open Biofilter Backwash Waste Valve
Ozone Contactor Calculated LRV – Virus	<120% LRV Goal	<110% LRV Goal	%	Open Biofilter Backwash Waste Valve
Biofilter Individual Effluent Turbidity	0.1	0.15	NTU	Place That Biofilter in Filter To Waste
Biofilter Combined Filter Effluent Turbidity	0.1	0.15	NTU	Place Biofilters in Filter To Waste
GAC Combined Effluent TOC, instantaneous online analyzer	4.0	5.0	mg/L	Divert SWIFT Water
UV Reactor Dose	<120% of Dose Setpoint	<105% of Dose Setpoint	%	Divert SWIFT Water
GAC Combined Effluent Nitrite	0.25	0.50	mg/L-N	Divert SWIFT Water
SWIFT Water TN	4.5	5.0	mg/L-N	Divert SWIFT Water
Ozone dose	70	80	lbs/day	Place Biofilters in Filter To Waste
Tasting System Free Chlorine CT	<110% of Required CT	<100% of Required CT	mg-min/L	Shut Down Tasting System
Tasting System Total Ammonia	0.1	0.3	mg/L-N	Shut Down Tasting System

Table 5. Critical Control Points for the SRC

Table 6. SWIFT Water Quality Data

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples
Regulatory Parameters													
Total Nitrogen (TN)	mg/L	NA	0.50	Daily ³	2.75	4.08	19	3.22	5.26	25	2.69	3.96	28
NO ₃	mg/L	10	0.20	Daily ³	2.72	4.08	19	2.96	4.71	24	2.61	3.72	28
NO ₂	mg/L	1	0.01	Daily ³	<0.01	<0.01	19	<0.01	<0.01	24	<0.01	<0.01	28
Turbidity	NTU	NA	0.01	Continuous				Figure 1			Figure 1		
Total Organic Carbon (TOC)	mg/L	NA	0.10	3x/Wk ³	2.58	2.91	13	2.55	3.21	16	3.08	3.33	21
pH		NA	NA	Continuous				Figure 2			Figure 2		
TDS ⁴	mg/L	Potomac Aquifer System Range: 694-8,720	2.5	Monthly		616	1		558	1		526	1
Microorganisms													
Total Coliform	MPN/100 ml	MCLG = 0	1	Daily ³	<1	<1	18	<1	<1	24	<1	<1	28
E. coli	MPN/100 ml	NA	1	Weekly	<1	<1	18	<1	<1	24	<1	<1	28
Disinfection Byproducts													
Bromate	µg/L	10	0.15	Monthly		1.92	1		2.11	1		2.79	1
Trihalomethanes													
Bromodichloromethane	µg/L		1.00	Monthly		1.20	1		<1.00	1		<1.00	1
Bromoform	µg/L		1.00	Monthly		3.77	1		2.02	1		3.33	1
Chloroform	µg/L		1.00	Monthly		1.06	1		<1.00	1		<1.00	1
Dibromochloromethane	µg/L		1.00	Monthly		3.68	1		2.56	1		2.90	1
Total Trihalomethanes	µg/L	80				9.70	1		4.59	1		6.22	1
HAAs													
Dichloroacetic acid	µg/L		0.60	Monthly		2.02	1		1.89	1		1.63	1
Trichloroacetic acid	µg/L		0.20	Monthly		0.62, NQ1	1		0.26, NQ1	1		0.21	1
Monochloroacetic acid	µg/L		0.60	Monthly		<0.60	1		<0.60	1		<0.60	1
Bromoacetic acid	µg/L		0.40	Monthly		0.99, NQ1	1		0.78, NQ1	1		0.96, NQ1	1
Dibromoacetic acid	µg/L		0.20	Monthly		9.30	1		4.69	1		8.08	1
Total Haloacetic Acids	µg/L	60				12.9	1		7.62	1		10.9	1
Disinfectants⁵													
Monochloramine (as Cl ₂)	mg/L	4		Continuous	0.20	2.09		0.04	0.87		0.02	0.05	
Chlorine (as Cl ₂)	mg/L	4		Continuous	2.54	3.16		2.84	3.63		2.39	2.81	
Inorganic Chemical													
Arsenic	µg/L	10	1.00	Monthly		<1.00	1		0.33	1		<0.50	1
Barium	mg/L	2	0.005	Monthly		0.005	1		0.007	1		0.006	1
Fluoride	mg/L	4.0	0.050	Monthly	0.740	0.838	19	0.722	0.814	25	0.710	0.831	28
Thallium	µg/L	2	0.20	Monthly		<0.20	1		<0.10	1		0.14	1
Radionuclides													
Beta particles and photon emitters	pCi/L	4 mrem/yr ⁶	3	Monthly		12	1		13	1		14	1

Table 6. SWIFT Water Quality Data

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples
Non-regulatory Performance Indicators													
Public Health Indicators		Trigger Limits											
1,4-dioxane	µg/L	1	0.06	Quarterly	0.27	0.29	3	0.24	0.26	3	0.27	0.32	5
Perfluorooctanoic Acid (PFOA)	ng/L	70 (PFOA+PFOS)	2	Quarterly		4	1						
Treatment Efficacy Indicators		Trigger Limits											
Sucralose	ng/L	150,000,000	1000	Quarterly		2700	1		2900	1		8100	1
Additional Monitoring (Ozone & UV LRV)													
					Minimum			Minimum			Minimum		
Ozone Virus LRV				Continuous	4.52	3.83		4.65	4.03		4.53	4.22	
Ozone Giardia LRV				Continuous	2.22	1.89		2.26	1.95		2.27	2.09	
UV Dose Reactor 1	mJ/cm ²			Continuous	>186	>186		>186	>186		>186	>186	
UV Virus LRV Reactor 1				Continuous	>4	>4		>4	>4		>4	>4	
UV Dose Reactor 2	mJ/cm ²			Continuous	>186	>186		>186	>186		>186	>186	
UV Virus LRV Reactor 2				Continuous	>4	>4		>4	>4		>4	>4	

¹ When minimum reporting limits varied during the quarter, the highest minimum reporting limit used is identified.

² Analytical results less than the reporting limit were treated as zero for the purposes of the averaging calculation.

³ Daily samples are typically not collected on days in which there is no or limited recharge. TOC sample collection occurs routinely on Monday through Friday when recharging. Limited or inconsistent recharge impacts the collection of daily samples, particularly for the microbiological samples collected for total coliform and E coli which have limited holding time requirements. In January, limited or no recharge impacted eleven days of sampling. One additional analysis was missed for total coliform and E. coli in January when a sample container was broken in transport to the laboratory. In February, limited or no recharge impacted four days of sampling. In March, limited or no recharge impacted four days of sampling.

⁴ TDS of the Potomac Aquifer System is based on the averages within the upper, middle and lower Potomac Aquifer as determined during baseline monitoring.

⁵ The maximum residual disinfectant level (or MRDL) MCL for monochloramine and chlorine are based on annual averages.

⁶ The measurement unit for beta particles and photon emitters is pCi/L while the MCL is expressed as mrem/yr. Per EPA's Implementation Guidance for Radionuclides (EPA 816-F-00-002, March 2002), the screening threshold for beta particles and photon emitters is 50 pCi/L. If sample concentrations exceed 50 pCi/L, each individual beta particle and photon emitter is converted from pCi/L to mrem using the EPA designated conversion tables, currently available in the referenced document.

Contract Laboratory Flags

NQ1: Value not for regulatory use - high degree of uncertainty

Recharge Statistics

The total volume recharged during this operational period was 29.0 million gallons. The backflushed volume was 5.8 million gallons for a net recharge of 23.2 million gallons (Figure 3). Brief backflushing periods occur as part of routine well maintenance on an approximate daily basis. From the start of operation through the end of this reporting period, the SRC has recharged a total volume of 560.5 million gallons.

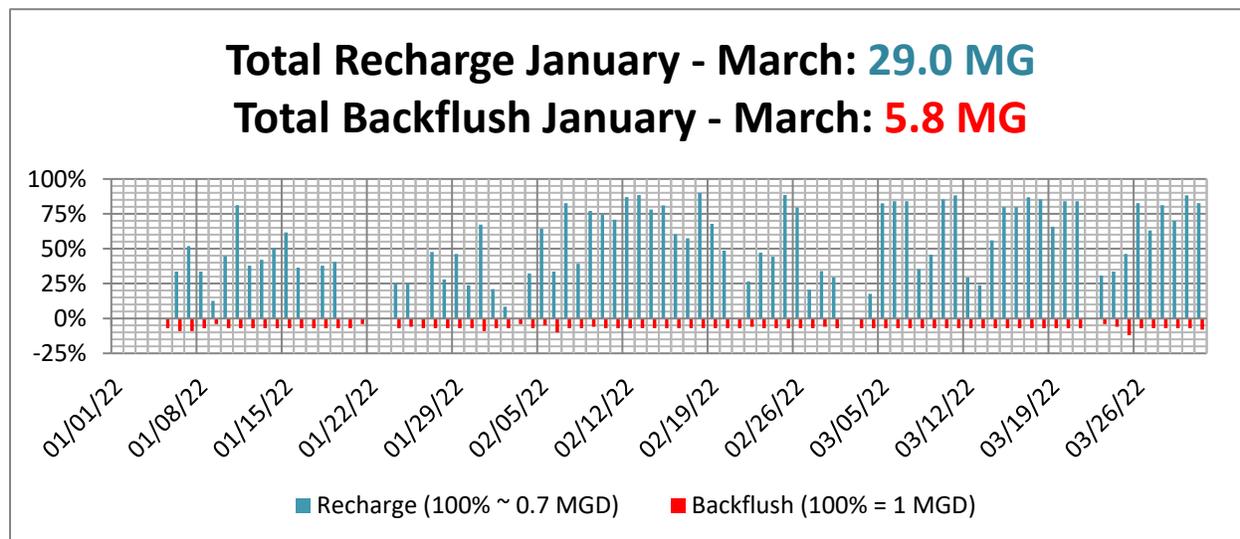


Figure 3: Recharge and Backflush Volumes, January 1 – March 31, 2022

HRSD has developed an internal target to recharge 75% of a SWIFT facility's operational capacity. This is a particularly relevant planning target for full-scale operations and HRSD is striving to meet this target at the SRC. Operational redundancies will exist at full-scale facilities (e.g., multiple recharge wells) which will likely result in a higher rate of recharge at full-scale.

The recharge capacity of TW-1 has slowly diminished since the well rehabilitation completed in Quarter 1 of 2021. To compensate for the reduced injectivity and preserve capacity until NP_MAR_01 is operational the recharge flow to TW-1 has been reduced. The well recharge target was initially adjusted to 600 gallons per minute (gpm, equivalent to 0.864 MGD), down from 700 gpm (~1 MGD) and more recently adjusted to 500 gpm (0.72 MGD). Recharge well capacity will continue to be monitored and the recharge flow will be adjusted as necessary; the SRC 75% target will be evaluated against the adjusted flow.

Figure 4 depicts the operational activity for this monitoring period identifying the percentage of operational time spent in recharge as well as the general factors precluding recharge.

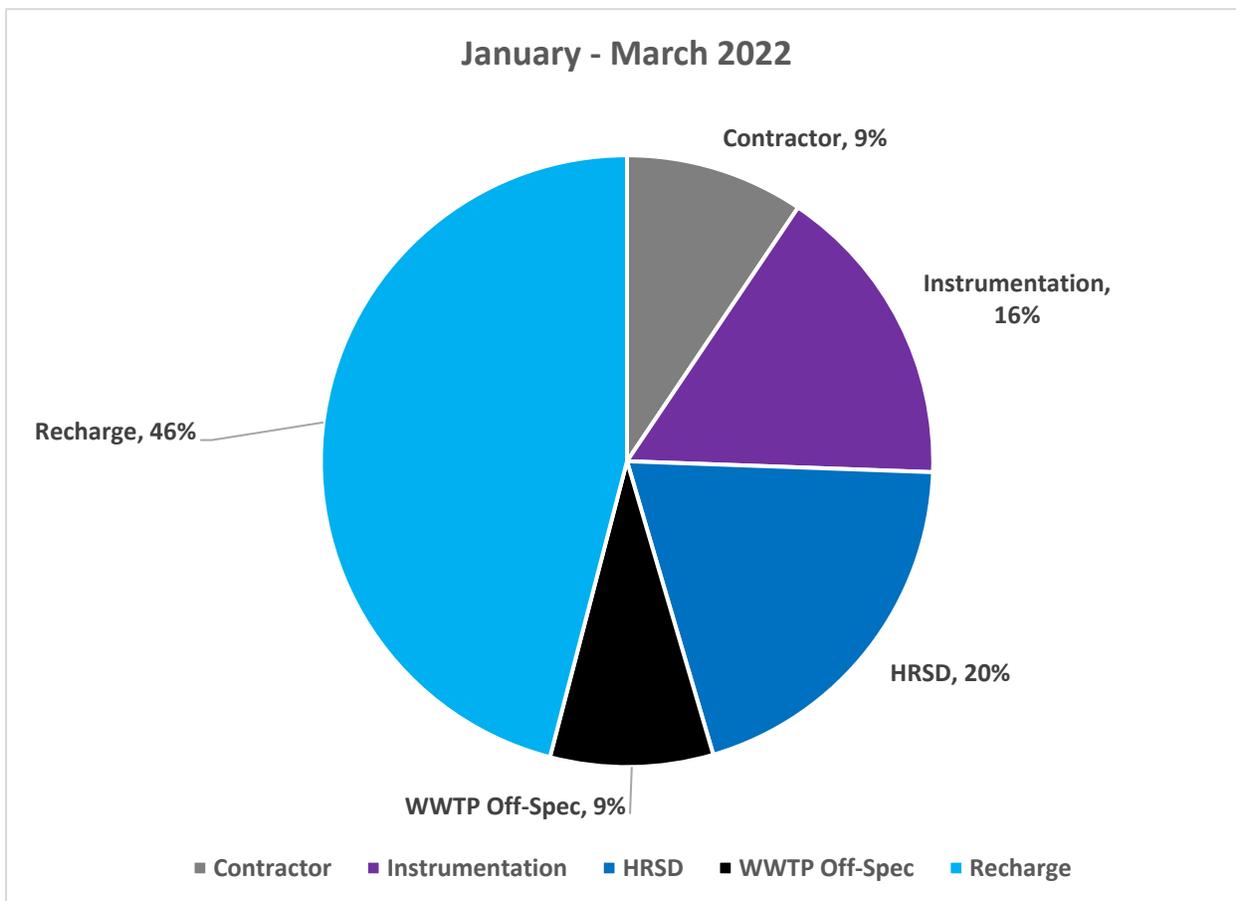


Figure 4: Operational activity for monitoring period. Notes: *Recharge*: Recharge of SWIFT Water; *WWTP Off-Spec*: Influent to the SWIFT facility (wastewater facility secondary clarifier effluent) does not meet influent quality requirements (e.g. elevated TOC or TN, or WWTP repairs); *HRSD*: Broad category covering activity within SWIFT facility that may lead to shut-down (e.g. maintenance and repairs, operational problems); *Contractor*: Recharge suspended to accommodate contractor activity at the AWT and/or recharge well. *Instrumentation*: On-line analyzer and/or instrumentation maintenance and repair.

Conventional Monitoring Wells

The conventional monitoring well for the upper zone of the Potomac Aquifer (MW-UPA), located approximately 400 ft from the recharge well, has been routinely monitored to detect the arrival of the recharge front. The recharge front arrived at MW-UPA in the fall of 2019 as evidenced by increasing Total Organic Carbon (TOC) concentrations. TOC observations in the monitoring wells located in the middle and lower zones of the Potomac Aquifer (MW-MPA, MW-LPA) remain < 1.0 mg/L. However, a gradual increase in TOC was observed in MW-MPA in 2021 and 1,4 dioxane has been detected near the reporting limit consistently since late December of 2020 in MW-MPA (Figures 5 and 6).

This indicates that the recharge front has reached the MW-MPA. To date, only four indicator compounds have been detected in either MW-UPA or MW-MPA. In the 2021 monitoring period, DEET was detected in a single instance in MW-UPA in August 2021 at a concentration of 12 ng/L. NDMA was also detected on four occasions during this period at 2 ng/L in MW-UPA, with the last detection in August 2021. Both sucralose and 1,4-dioxane are observed in both MW-UPA and MW-MPA more frequently, included within this Quarter 1 2022 monitoring period. Trend data associated with these two compounds is presented in Figures 6 and 7. All reported values for these indicators are less than the action thresholds (“trigger values”) identified in Table 2 of this report. Further, results for all regulatory parameters are less than the PMCL and all regulated organics were non-detect. Arsenic observations are described in further detail in the sections below.



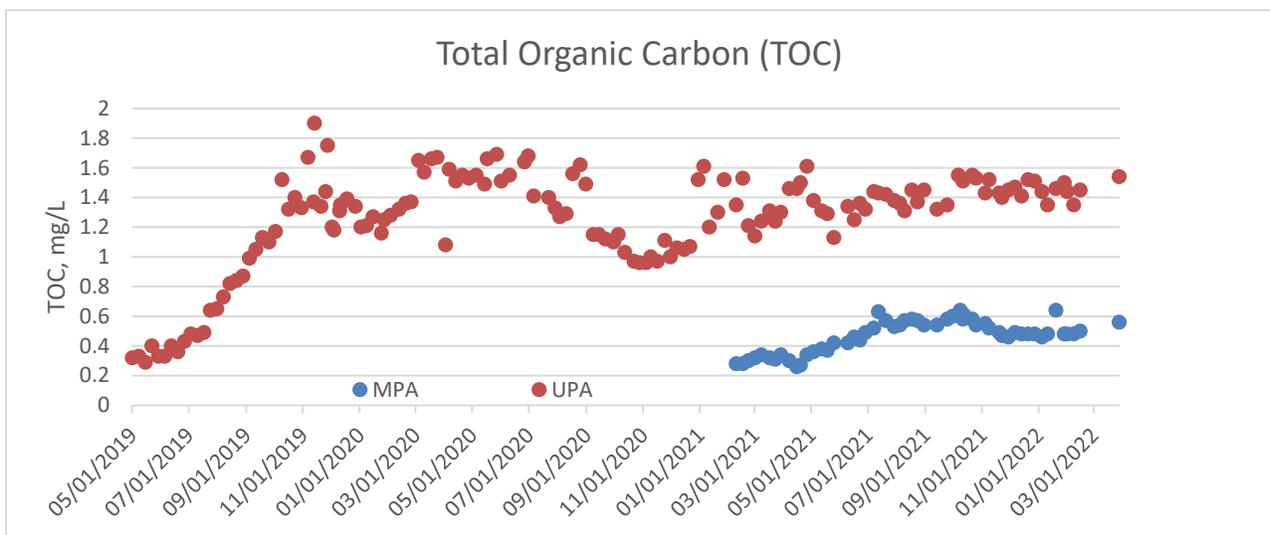


Figure 5: TOC concentration in the Upper and Middle Potomac conventional monitoring wells, MW-UPA and MW-MPA.

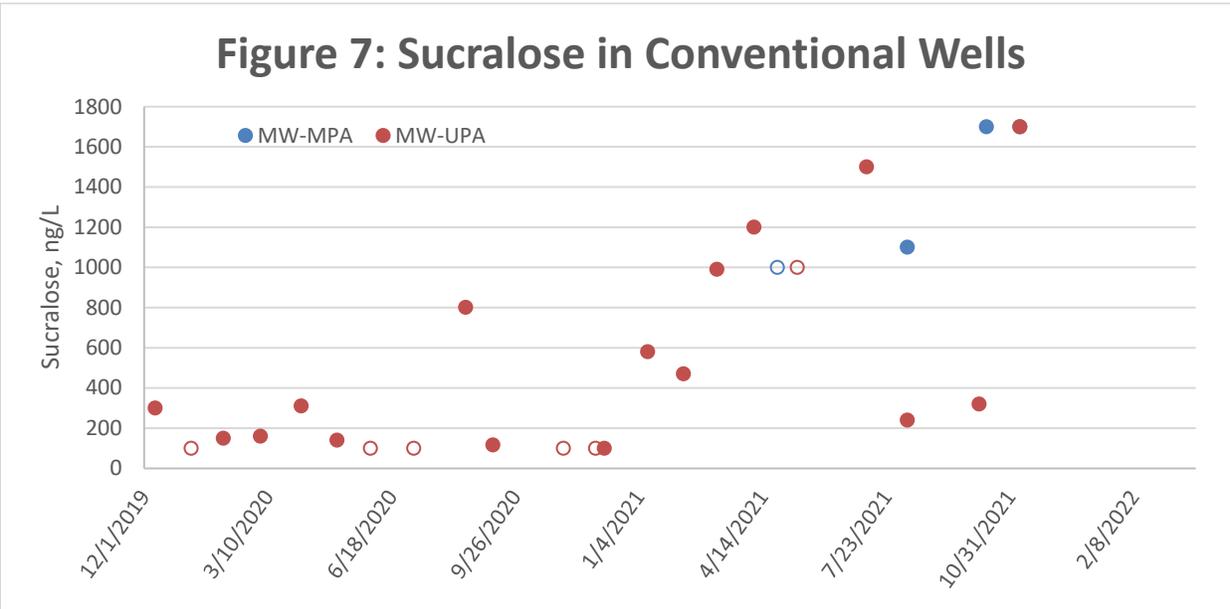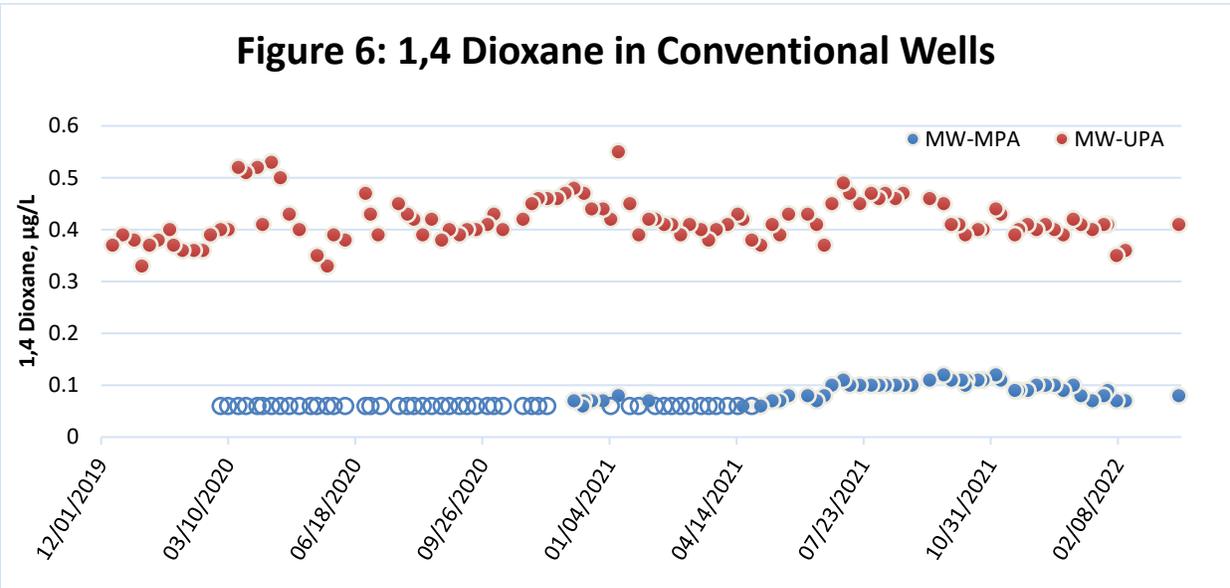

Figures 6 and 7: 1,4 dioxane and sucralose trending in MW-UPA and MW-MPA. Open circles represent data that is less than the reporting limit.

Arsenic in MW-SAT Update

HRSD continues to closely track arsenic (As) concentrations in MW-SAT following an observed increase in As in screen interval 9 from July to October of 2021. This increase in As is associated with a decrease in SWIFT Water dissolved oxygen (DO) during the same period. Oxygen supplied by ozonation was consumed later in the treatment process (BAF and GAC) by increased biological activity due to summer temperature conditions and aged GAC media. The lack of DO caused the SWIFT Water to fall below

the solubility limit of iron and dissolved the hydrous ferric oxide (HFO) coatings that passivate the aquifer minerals and sorb arsenic that might be migrating in the water (reductive dissolution).

To mitigate this condition in the future, HRSD is upgrading the system to include the Speece cone which will provide us the ability to introduce add DO upstream of GAC. This will provide us the opportunity to test our hypothesis that the combination of Total Organic Carbon (TOC) approaching 4 mg/L and low DO caused reductive dissolution of HFO and sorbed As. With the upgraded system (including the Speece cone), we can create the following conditions and monitor As in MW_SAT:

- High DO, TOC approaching 4 mg/L
- Low DO, TOC approaching 4 mg/L
- High DO, low TOC
- Low DO, low TOC

Over this monitoring period, screen interval 9 continued to have the highest observable arsenic concentration at 6.43 µg/L in the month of February. It is unclear as to the cause though potentially the lack of recharge during the month of January was a contributing factor in creating a short-term, localized increase in screen 9. Concentrations in samples from screen 9 have ranged between 2.72 µg/L and 5.74 µg/L since February with the latest March sample at 4.39 µg/L. HRSD will continue monitoring during recharge in the most transmissive screens of MW-SAT and in the conventional wells. Sample results for screen intervals with an observed maximum monthly concentration > 1.50 µg/L are documented in Table 7.

Table 7: Total arsenic concentration in selected screen intervals of MW-SAT. Total arsenic concentration in the remaining screen intervals was ≤ 1.50 µg/L in each month of the monitoring period. Total arsenic concentration in the conventional monitoring wells, MW-UPA and MW-MPA as well as SWIFT Water remained < 1.00 µg/L during the monitoring period.

MW-Sat Screen	Total Arsenic, µg/L					
	January 2022		February 2022		March 2022	
	Max	Avg	Max	Avg	Max	Avg
2	-	-	2.56	2.17	2.38	1.71
3	-	-	1.71	1.63	1.67	1.30
8	2.60	2.36	2.69	2.41	2.76	2.47
9	2.19	2.54	6.43	3.72	5.74	5.20

Appendix
SRC Monitoring Data for SWIFT Water Quality Regulatory Targets

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples
Regulatory Parameters													
Total Nitrogen (TN)	mg/L	NA	0.50	Daily ³	2.75	4.08	19	3.22	5.26	25	2.69	3.96	28
NO ₃	mg/L	10	0.20	Daily ³	2.72	4.08	19	2.96	4.71	24	2.61	3.72	28
NO ₂	mg/L	1	0.01	Daily ³	<0.01	<0.01	19	<0.01	<0.01	24	<0.01	<0.01	28
Turbidity	NTU	NA	0.01	Continuous				Figure 1			Figure 1		
Total Organic Carbon (TOC)	mg/L	NA	0.10	3x/Wk ³	2.58	2.91	13	2.55	3.21	16	3.08	3.33	21
pH		NA	NA	Continuous				Figure 2			Figure 2		
TDS ⁴	mg/L	Potomac Aquifer System Range: 694-8,720	2.5	Monthly		616	1		558	1		526	1
Microorganisms													
Total Coliform	MPN/100 ml	MCLG = 0	1	Daily ³	<1	<1	18	<1	<1	24	<1	<1	28
E. coli	MPN/100 ml	NA	1	Weekly	<1	<1	18	<1	<1	24	<1	<1	28
Cryptosporidium	oocysts/L	Treatment Technique, MCLG = 0	0.093	Quarterly		<0.093	1						
Giardia lamblia	oocysts/L	Treatment Technique, MCLG = 0	0.093	Quarterly		<0.093	1						
Legionella	MPN/100 ml	Treatment Technique, MCLG = 0	1	Quarterly					<1	1			
Disinfection Byproducts													
Bromate	µg/L	10	0.15	Monthly		1.92	1		2.11	1		2.79	1
Chlorite	mg/L	1.0	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Trihalomethanes													
Bromodichloromethane	µg/L		1.00	Monthly		1.20	1		<1.00	1		<1.00	1
Bromoform	µg/L		1.00	Monthly		3.77	1		2.02	1		3.33	1
Chloroform	µg/L		1.00	Monthly		1.06	1		<1.00	1		<1.00	1
Dibromochloromethane	µg/L		1.00	Monthly		3.68	1		2.56	1		2.90	1
Total Trihalomethanes	µg/L	80				9.70	1		4.59	1		6.22	1

Appendix
SRC Monitoring Data for SWIFT Water Quality Regulatory Targets

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples
HAAs													
Dichloroacetic acid	µg/L		0.60	Monthly		2.02	1		1.89	1		1.63	1
Trichloroacetic acid	µg/L		0.20	Monthly		0.62, NQ1	1		0.26, NQ1	1		0.21	1
Monochloroacetic acid	µg/L		0.60	Monthly		<0.60	1		<0.60	1		<0.60	1
Bromoacetic acid	µg/L		0.40	Monthly		0.99, NQ1	1		0.78, NQ1	1		0.96, NQ1	1
Dibromoacetic acid	µg/L		0.20	Monthly		9.30	1		4.69	1		8.08	1
Total Haloacetic Acids	µg/L	60				12.9	1		7.62	1		10.9	1
Disinfectants⁵													
Monochloramine (as Cl ₂)	mg/L	4		Continuous	0.20	2.09		0.04	0.87		0.02	0.05	
Chlorine (as Cl ₂)	mg/L	4		Continuous	2.54	3.16		2.84	3.63		2.39	2.81	
Inorganic Chemical													
Antimony	µg/L	6	2.00	Monthly		<2.00	1		<0.50	1		<2.00	1
Arsenic	µg/L	10	1.00	Monthly		<1.00	1		0.33	1		<0.50	1
Asbestos	MFL	7	0.20	Monthly		<0.20	1		<0.20	1		<0.20	1
Barium	mg/L	2	0.005	Monthly		0.005	1		0.007	1		0.006	1
Beryllium	µg/L	4	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Cadmium	µg/L	5	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Chromium (total)	µg/L	100	2.50	Monthly		<0.50	1		<2.50	1		<1.00	1
Copper	mg/L	1.3 (action level)	0.005	Monthly		<0.005	1		<0.005	1		<0.005	1
Cyanide (total)	µg/L	200	10	Monthly		<10	1		<10	1		<10	1
Fluoride	mg/L	4.0	0.050	Monthly	0.740	0.838	19	0.722	0.814	25	0.710	0.831	28
Lead	µg/L	15 (action level)	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Mercury	µg/L	2	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Selenium	µg/L	50	5.00	Monthly		<5.00	1		<5.00	1		<5.00	1
Thallium	µg/L	2	0.20	Monthly		<0.20	1		<0.10	1		0.14	1
Organic Chemicals													
Acrylamide	µg/L	Treatment Technique, MCLG = 0	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Alachlor	µg/L	2	0.05	Monthly		<0.05	1		<0.05	1		<0.05	1
Atrazine	µg/L	3	0.05	Monthly		<0.05	1		<0.05	1		<0.05	1
Benzo(a)pyrene (PAHs)	µg/L	0.2	0.02	Monthly		<0.02	1		<0.02	1		<0.02	1
Di(2-ethylhexyl) adipate	µg/L	400	0.60	Monthly		<0.60	1		<0.60	1		<0.60, BM	1
Di(2-ethylhexyl) phthalate	µg/L	6	0.60	Monthly		<0.60	1		<0.60	1		<0.60, LE, BM	1

Appendix
SRC Monitoring Data for SWIFT Water Quality Regulatory Targets

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples
Hexachlorocyclopentadiene	µg/L	50	0.05	Monthly		<0.05	1		<0.05	1		<0.05	1
Hexachlorobenzene	µg/L	1	0.05	Monthly		<0.05	1		<0.05	1		<0.05	1
Simazine	µg/L	4	0.05	Monthly		<0.05	1		<0.05	1		<0.05	1
Carbofuran	µg/L	40	0.50	Monthly		<0.50	1		<0.10, H, H3	1		<0.10	1
Oxamyl (Vydate)	µg/L	200	0.50	Monthly		<0.50	1		<0.10, H, H3	1		<0.10	1
Chlordane	µg/L	2	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Endrin	µg/L	2	0.01	Monthly		<0.01	1		<0.01	1		<0.01	1
Heptachlor	µg/L	0.4	0.01	Monthly		<0.01	1		<0.01	1		<0.01	1
Heptachlor Epoxide	µg/L	0.2	0.01	Monthly		<0.01	1		<0.01	1		<0.01	1
Lindane	µg/L	0.2	0.01	Monthly		<0.01	1		<0.01	1		<0.01	1
Methoxychlor	µg/L	40	0.05	Monthly		<0.05	1		<0.05	1		<0.05	1
Toxaphene	µg/L	3	0.50	Monthly		<0.50	1		<0.50	1		<0.50	1
PCB Arochlor1016	µg/L		0.08	Monthly		<0.08	1		<0.08	1		<0.08	1
PCB Arochlor1221	µg/L		0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
PCB Arochlor1232	µg/L		0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
PCB Arochlor1242	µg/L		0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
PCB Arochlor1248	µg/L		0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
PCB Arochlor1254	µg/L		0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
PCB Arochlor1260	µg/L		0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Total Polychlorinated Biphenyls (PCBs)	µg/L	0.5				<0.10	1		<0.10	1		<0.10	1
2,4-D	µg/L	70	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
Dalapon	µg/L	200	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Picloram	µg/L	500	0.10	Monthly		<0.10	1		<0.10	1		<0.10	1
2,4,5-TP (Silvex)	µg/L	50	0.20	Monthly		<0.20	1		<0.20	1		<0.20	1
Dinoseb	µg/L	7	0.20	Monthly		<0.20	1		<0.20	1		<0.20	1
Pentachlorophenol	µg/L	1	0.04	Monthly		<0.04	1		<0.04	1		<0.04, B4	1
Dioxin (2,3,7,8-TCDD)	pg/L	30	5.00	Monthly		<5.00	1		<5.00	1		<5.00	1
Diquat	µg/L	20	0.4	Monthly		<0.4	1		<0.4	1		<0.4	1
Endothall	µg/L	100	5.0	Monthly		<5.0	1		<5.0	1		<5.0	1
Epichlorohydrin	µg/L	Treatment Technique, MCLG = 0	4.0	Monthly		<1.0	1		<4.0, H1	1		<4.0	1
Glyphosphate	µg/L	700	6.0	Monthly		<6.0	1		<6.0, H, H3	1		<6.0	1
Benzene	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Carbon Tetrachloride	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1

Appendix
SRC Monitoring Data for SWIFT Water Quality Regulatory Targets

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples
Chlorobenzene	µg/L	100	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
2-dibromo-3-chloropropane (DBCP)	µg/L	0.2	0.02	Monthly		<0.02	1		<0.02	1		<0.02	1
o-Dichlorobenzene	µg/L	600	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
p-Dichlorobenzene	µg/L	75	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
1,2-Dichloroethane	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
1,1-Dichloroethylene	µg/L	7	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
cis-1,2-Dichloroethylene	µg/L	70	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
trans-1,2-Dichloroethylene	µg/L	100	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Dichloromethane	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
1,2-Dichloropropane	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Ethylbenzene	µg/L	700	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Ethylene Dibromide (EDB)	µg/L	0.05	0.02	Monthly		<0.02	1		<0.02	1		<0.02	1
Styrene	µg/L	100	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Tetrachloroethylene	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Toluene	µg/L	1,000	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
1,2,4-Trichlorobenzene	µg/L	70	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
1,1,1-Trichloroethane	µg/L	200	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
1,1,2-Trichloroethane	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Trichloroethylene	µg/L	5	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Vinyl Chloride	µg/L	2	1.00	Monthly		<1.00	1		<1.00	1		<1.00	1
Total Xylene	µg/L	10,000	3.00	Monthly		<3.00	1		<3.00	1		<3.00	1
Radionuclides													
Alpha particles	pCi/L	15	3	Monthly		<3	1		<3	1		<3	1
Beta particles and photon emitters	pCi/L	4 mrem/yr ⁶	3	Monthly		12	1		13	1		14	1
Radium 226	pCi/L	5 (226+228)	1.0	Monthly		<1.0	1		<1.0	1		<1.0	1
Radium 228	pCi/L	5 (226+228)	1.0	Monthly		<1.0	1		<1.0, L4	1		<1.0	1
Uranium	µg/L	30	0.1	Monthly		<0.10	1		<0.10	1		<0.10	1
Strontium-90	pCi/L	NA	2	Monthly		<0.256	1		<0.422	1		<2.00, U	1
Tritium	pCi/L	NA	1000	Monthly		<1000, U	1		<1000, U	1		<1000, U	1

Appendix
SRC Monitoring Data for SWIFT Water Quality Regulatory Targets

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples
Non-regulatory Performance Indicators													
Public Health Indicators		Trigger Limits											
1,4-dioxane	µg/L	1	0.06	Quarterly	0.27	0.29	3	0.24	0.26	3	0.27	0.32	5
17-β-estradiol	ng/L	0.9	0.40	Quarterly		<0.40	1						
DEET	ng/L	200,000	4.9	Quarterly		<4.9	1						
Ethinyl estradiol	ng/L	280	0.90	Quarterly		<0.90	1						
Diethyls(2-carboxyethyl)phosphine (TCEP)	ng/L	5,000	10	Quarterly		<10	1						
NDMA	ng/L	10	2.00	Quarterly	<2.00	<2.00	2	<2.00	<2.00	4	<2.00	<2.00	5
Perchlorate	µg/L	6	0.50	Quarterly		<0.50	1						
Perfluorooctanoic Acid (PFOA)	ng/L	70 (PFOA+PFOS)	2	Quarterly		4	1						
Perfluorooctanesulfonic Acid (PFOS)	ng/L	70 (PFOA+PFOS)	2	Quarterly		<2	1						
Treatment Efficacy Indicators		Trigger Limits											
Cotinine	ng/L	1,000	10	Quarterly		<10, LK, LM, R2	1						
Primidone	ng/L	10,000	5.0	Quarterly		<5.0	1						
Phenytoin (Dilantin)	ng/L	2,000	20	Quarterly		<20, R7	1						
Meprobamate	ng/L	200,000	5.0	Quarterly		<5.0, R7, V1	1						
Atenolol	ng/L	4,000	5.0	Quarterly		<5.0	1						
Carbamazepine	ng/L	10,000	5.0	Quarterly		<5.0	1						
Estrone	ng/L	320,000	2.0	Quarterly		<2.0	1						
Sucralose	ng/L	150,000,000	1000	Quarterly		2700	1		2900	1		8100	1
Triclosan	ng/L	210,000	25	Quarterly		<25	1		<25	1		<25	1
Additional Monitoring (Ozone & UV LRV)		Minimum											
Ozone Virus LRV				Continuous	4.52	3.83		4.65	4.03		4.53	4.22	
Ozone Giardia LRV				Continuous	2.22	1.89		2.26	1.95		2.27	2.09	
UV Dose Reactor 1	mJ/cm ²			Continuous	>186	>186		>186	>186		>186	>186	
UV Virus LRV Reactor 1				Continuous	>4	>4		>4	>4		>4	>4	
UV Dose Reactor 2	mJ/cm ²			Continuous	>186	>186		>186	>186		>186	>186	
UV Virus LRV Reactor 2				Continuous	>4	>4		>4	>4		>4	>4	

Appendix
SRC Monitoring Data for SWIFT Water Quality Regulatory Targets

Parameter	Units	Maximum Contaminant Level (MCL) or MCL Goal (MCLG) where numerical MCL not expressed. Values noted for indicator compounds are non-regulatory screening values	Minimum Report Level ¹	Required Monitoring Frequency	January 2022			February 2022			March 2022		
					Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples	Average ²	Maximum	Numer of Samples

¹ When minimum reporting limits varied during the quarter, the highest minimum reporting limit used is identified.

² Analytical results less than the reporting limit were treated as zero for the purposes of the averaging calculation.

³ Daily samples are typically not collected on days in which there is no or limited recharge. TOC sample collection occurs routinely on Monday through Friday when recharging. Limited or inconsistent recharge impacts the collection of daily samples, particularly for the microbiological samples collected for total coliform and E coli which have limited holding time requirements. In January, limited or no recharge impacted eleven days of sampling. One additional analysis was missed for total coliform and E. coli in January when a sample container was broken in transport to the laboratory. In February, limited or no recharge impacted four days of sampling. In March, limited or no recharge impacted four days of sampling.

⁴ TDS of the Potomac Aquifer System is based on the averages within the upper, middle and lower Potomac Aquifer as determined during baseline monitoring.

⁵ The maximum residual disinfectant level (or MRDL) MCL for monochloramine and chlorine are based on annual averages.

⁶ The measurement unit for beta particles and photon emitters is pCi/L while the MCL is expressed as mrem/yr. Per EPA's Implementation Guidance for Radionuclides (EPA 816-F-00-002, March 2002), the screening threshold for beta particles and photon emitters is 50 pCi/L. If sample concentrations exceed 50 pCi/L, each individual beta particle and photon emitter is converted from pCi/L to mrem using the EPA designated conversion tables, currently available in the referenced document.

Contract Laboratory Flags

B4: Target analyte detected in blank at or above method acceptance criteria.

BM: Target analyte detected in method blank above the MDL, but below the minimum reporting limit (MRL) and analyte not present in the sample, no impact on data.

H: Sample was prepped or analyzed beyond the specified holding time.

H1: Sample analysis performed past holding time.

H3: Sample was received and/or analysis requested past holding time.

L4: The associated blank spike recovery was below method acceptance limits.

LE: MRL Check recovery was above laboratory acceptance limits.

LK: The associated LCS/LFB recovery was above method acceptance limits. This target analyte was not detected in the sample.

LM: MRL Check recovery was above laboratory acceptance limits. This target analyte was not detected in the sample.

NQ1: Value not for regulatory use - high degree of uncertainty

R2: RPD/RSD exceeded the laboratory acceptance limit.

U: Results less than the sample detection limit.

V1: CCV recovery was above method acceptance limits. This target analyte was not detected in the sample.